


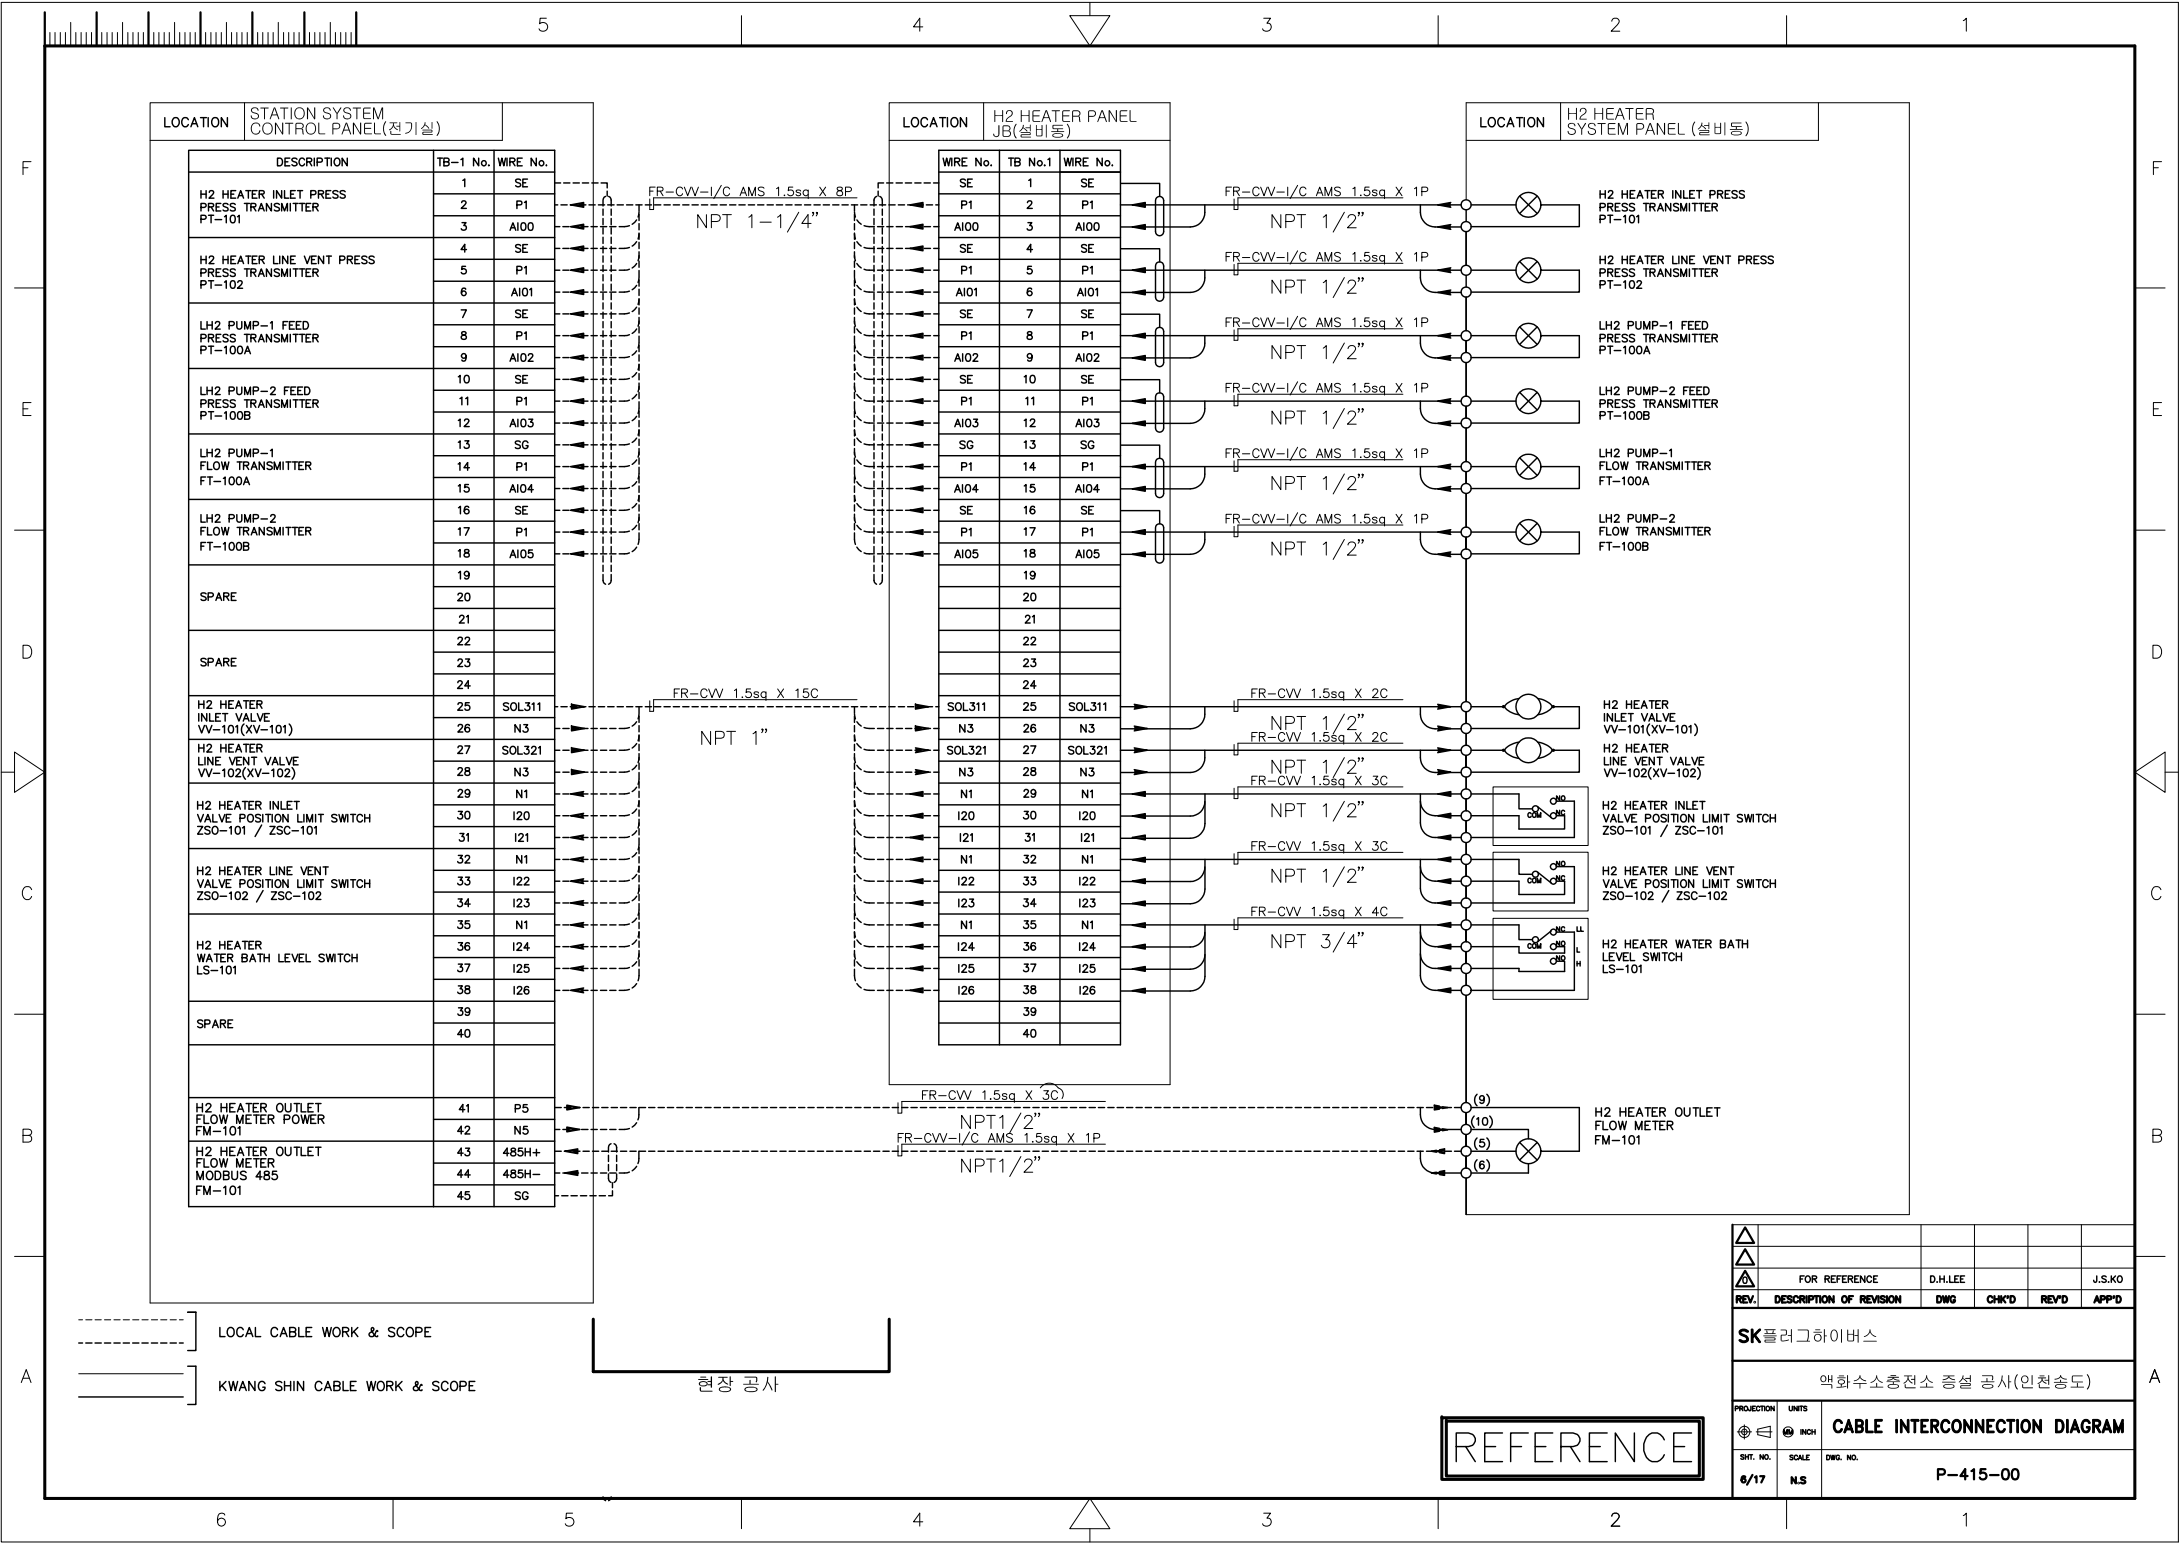


LOCATION STATION SYSTEM CONTROL PANEL(전기실)

DESCRIPTION	TB-1 No.	WIRE No.
H2 HEATER INLET PRESS PRESS TRANSMITTER PT-101	1	SE
	2	P1
	3	AI00
H2 HEATER LINE VENT PRESS PRESS TRANSMITTER PT-102	4	SE
	5	P1
	6	AI01
LH2 PUMP-1 FEED PRESS TRANSMITTER PT-100A	7	SE
	8	P1
	9	AI02
LH2 PUMP-2 FEED PRESS TRANSMITTER PT-100B	10	SE
	11	P1
	12	AI03
LH2 PUMP-1 FLOW TRANSMITTER FT-100A	13	SG
	14	P1
	15	AI04
LH2 PUMP-2 FLOW TRANSMITTER FT-100B	16	SE
	17	P1
	18	AI05
SPARE	19	
	20	
	21	
	22	
SPARE	23	
	24	
H2 HEATER INLET VALVE VV-101(XV-101)	25	SOL311
	26	N3
H2 HEATER LINE VENT VALVE VV-102(XV-102)	27	SOL321
	28	N3
H2 HEATER INLET VALVE POSITION LIMIT SWITCH ZSO-101 / ZSC-101	29	N1
	30	I20
	31	I21
H2 HEATER LINE VENT VALVE POSITION LIMIT SWITCH ZSO-102 / ZSC-102	32	N1
	33	I22
	34	I23
H2 HEATER WATER BATH LEVEL SWITCH LS-101	35	N1
	36	I24
	37	I25
	38	I26
SPARE	39	
	40	
H2 HEATER OUTLET FLOW METER POWER FM-101	41	P5
	42	N5
H2 HEATER OUTLET FLOW METER MODBUS 485 FM-101	43	485H+
	44	485H-
	45	SG

LOCATION H2 HEATER PANEL JB(설비동)

WIRE No.	TB No.1	WIRE No.
SE	1	SE
P1	2	P1
AI00	3	AI00
SE	4	SE
P1	5	P1
AI01	6	AI01
SE	7	SE
P1	8	P1
AI02	9	AI02
SE	10	SE
P1	11	P1
AI03	12	AI03
SG	13	SG
P1	14	P1
AI04	15	AI04
SE	16	SE
P1	17	P1
AI05	18	AI05
	19	
	20	
	21	
	22	
	23	
	24	
SOL311	25	SOL311
N3	26	N3
SOL321	27	SOL321
N3	28	N3
N1	29	N1
I20	30	I20
I21	31	I21
N1	32	N1
I22	33	I22
I23	34	I23
N1	35	N1
I24	36	I24
I25	37	I25
I26	38	I26
	39	
	40	

LOCATION H2 HEATER SYSTEM PANEL (설비동)

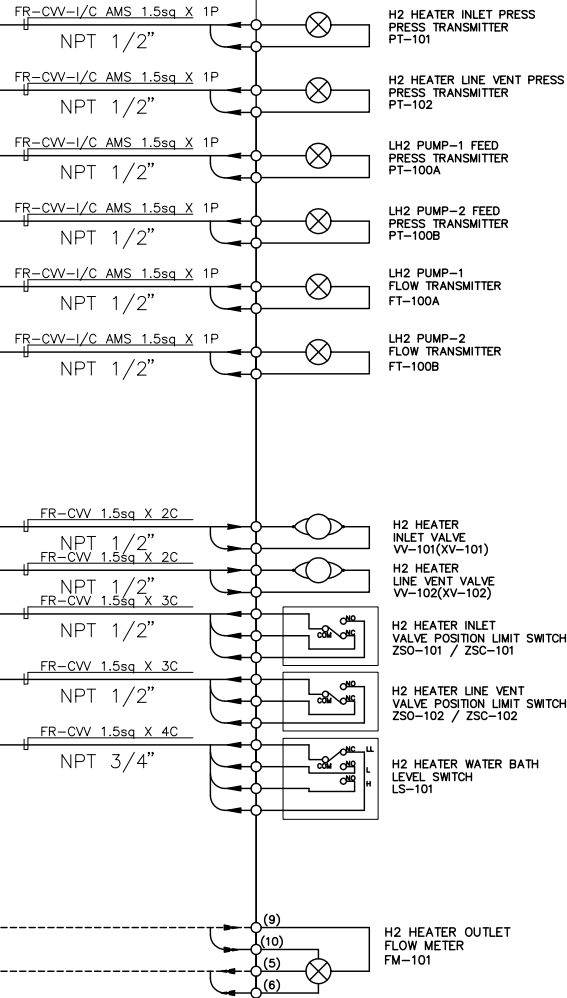


LOCAL CABLE WORK & SCOPE

KWANG SHIN CABLE WORK & SCOPE

현장 공사

REFERENCE

△					
△					
REV.	FOR REFERENCE	D.H.LEE			J.S.KO
	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이버스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
SHT. NO.	SCALE	DWG. NO.	P-415-00		
6/17	N.S				

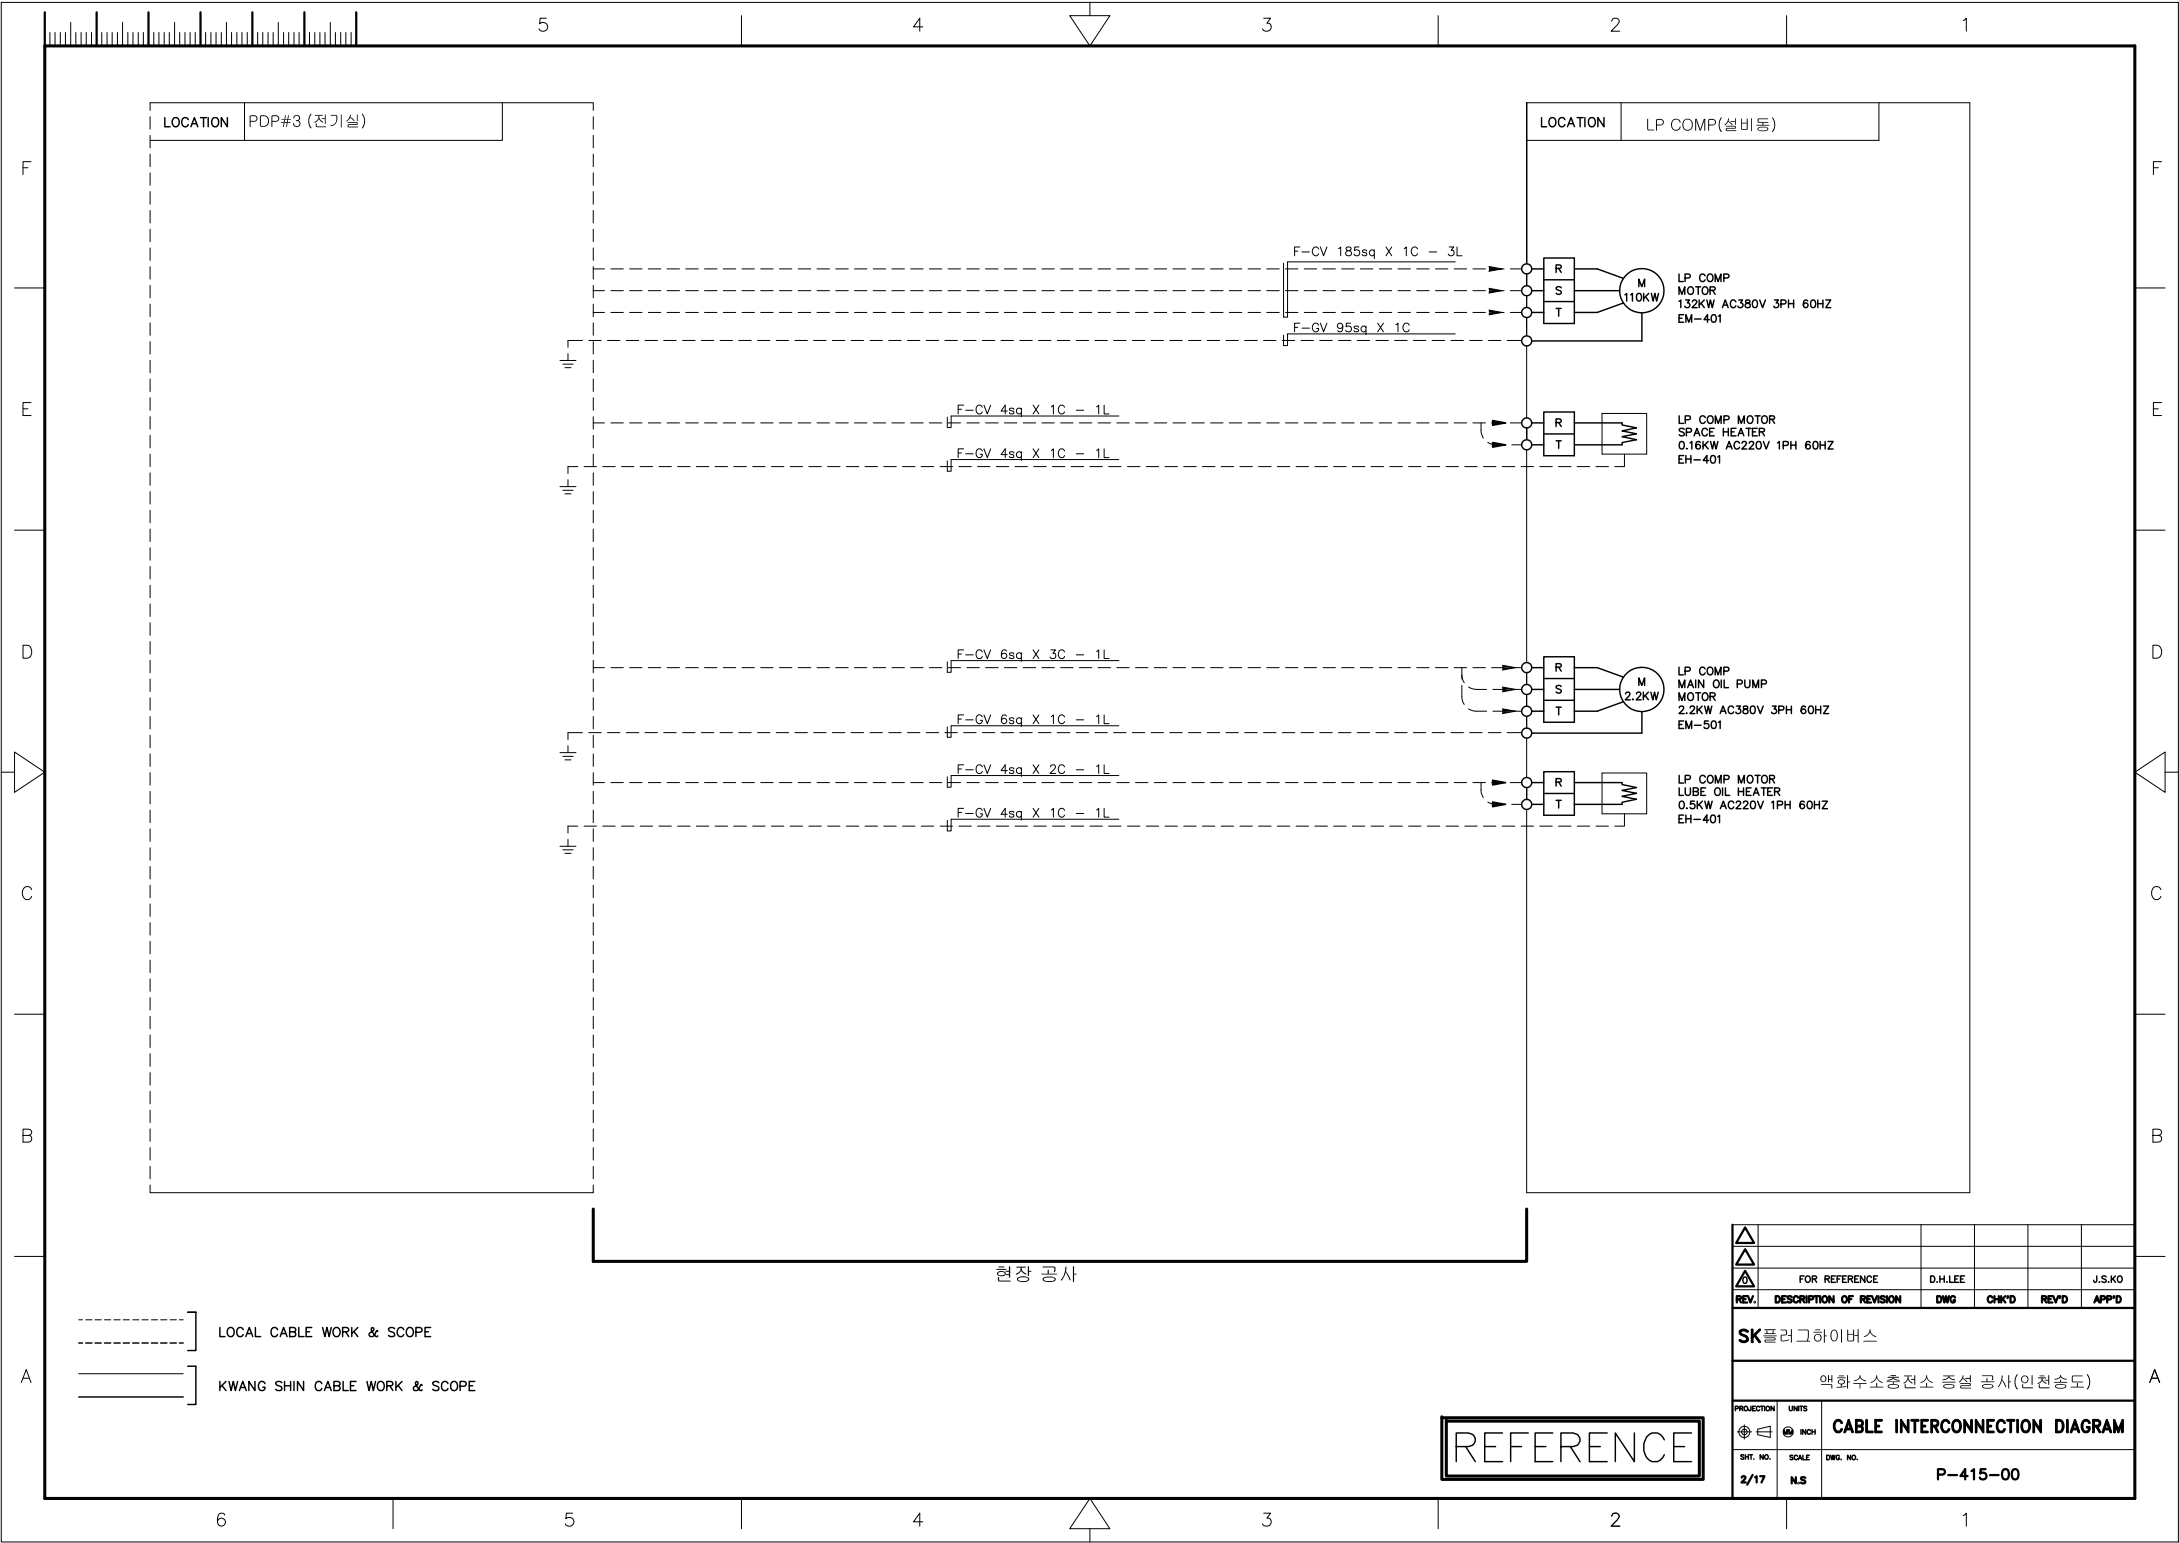

LOCATION PDP#3 (전기실)

LOCATION LP COMP(설비동)

F-CV 185sq X 1C - 3L

F-GV 95sq X 1C

F-CV 4sq X 1C - 1L


F-GV 4sq X 1C - 1L

F-CV 6sq X 3C - 1L


F-GV 6sq X 1C - 1L

F-CV 4sq X 2C - 1L


F-GV 4sq X 1C - 1L




LP COMP MOTOR
132KW AC380V 3PH 60HZ
EM-401



LP COMP MOTOR
SPACE HEATER
0.16KW AC220V 1PH 60HZ
EH-401



LP COMP MAIN OIL PUMP
MOTOR
2.2KW AC380V 3PH 60HZ
EM-501



LP COMP MOTOR
LUBE OIL HEATER
0.5KW AC220V 1PH 60HZ
EH-401


현장 공사


LOCAL CABLE WORK & SCOPE

KWANG SHIN CABLE WORK & SCOPE

REFERENCE

△					
△					
REV.	FOR REFERENCE	D.H.LEE			J.S.KO
	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이비스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
	 INCH	P-415-00			
SHT. NO.	SCALE				
2/17	N.S				

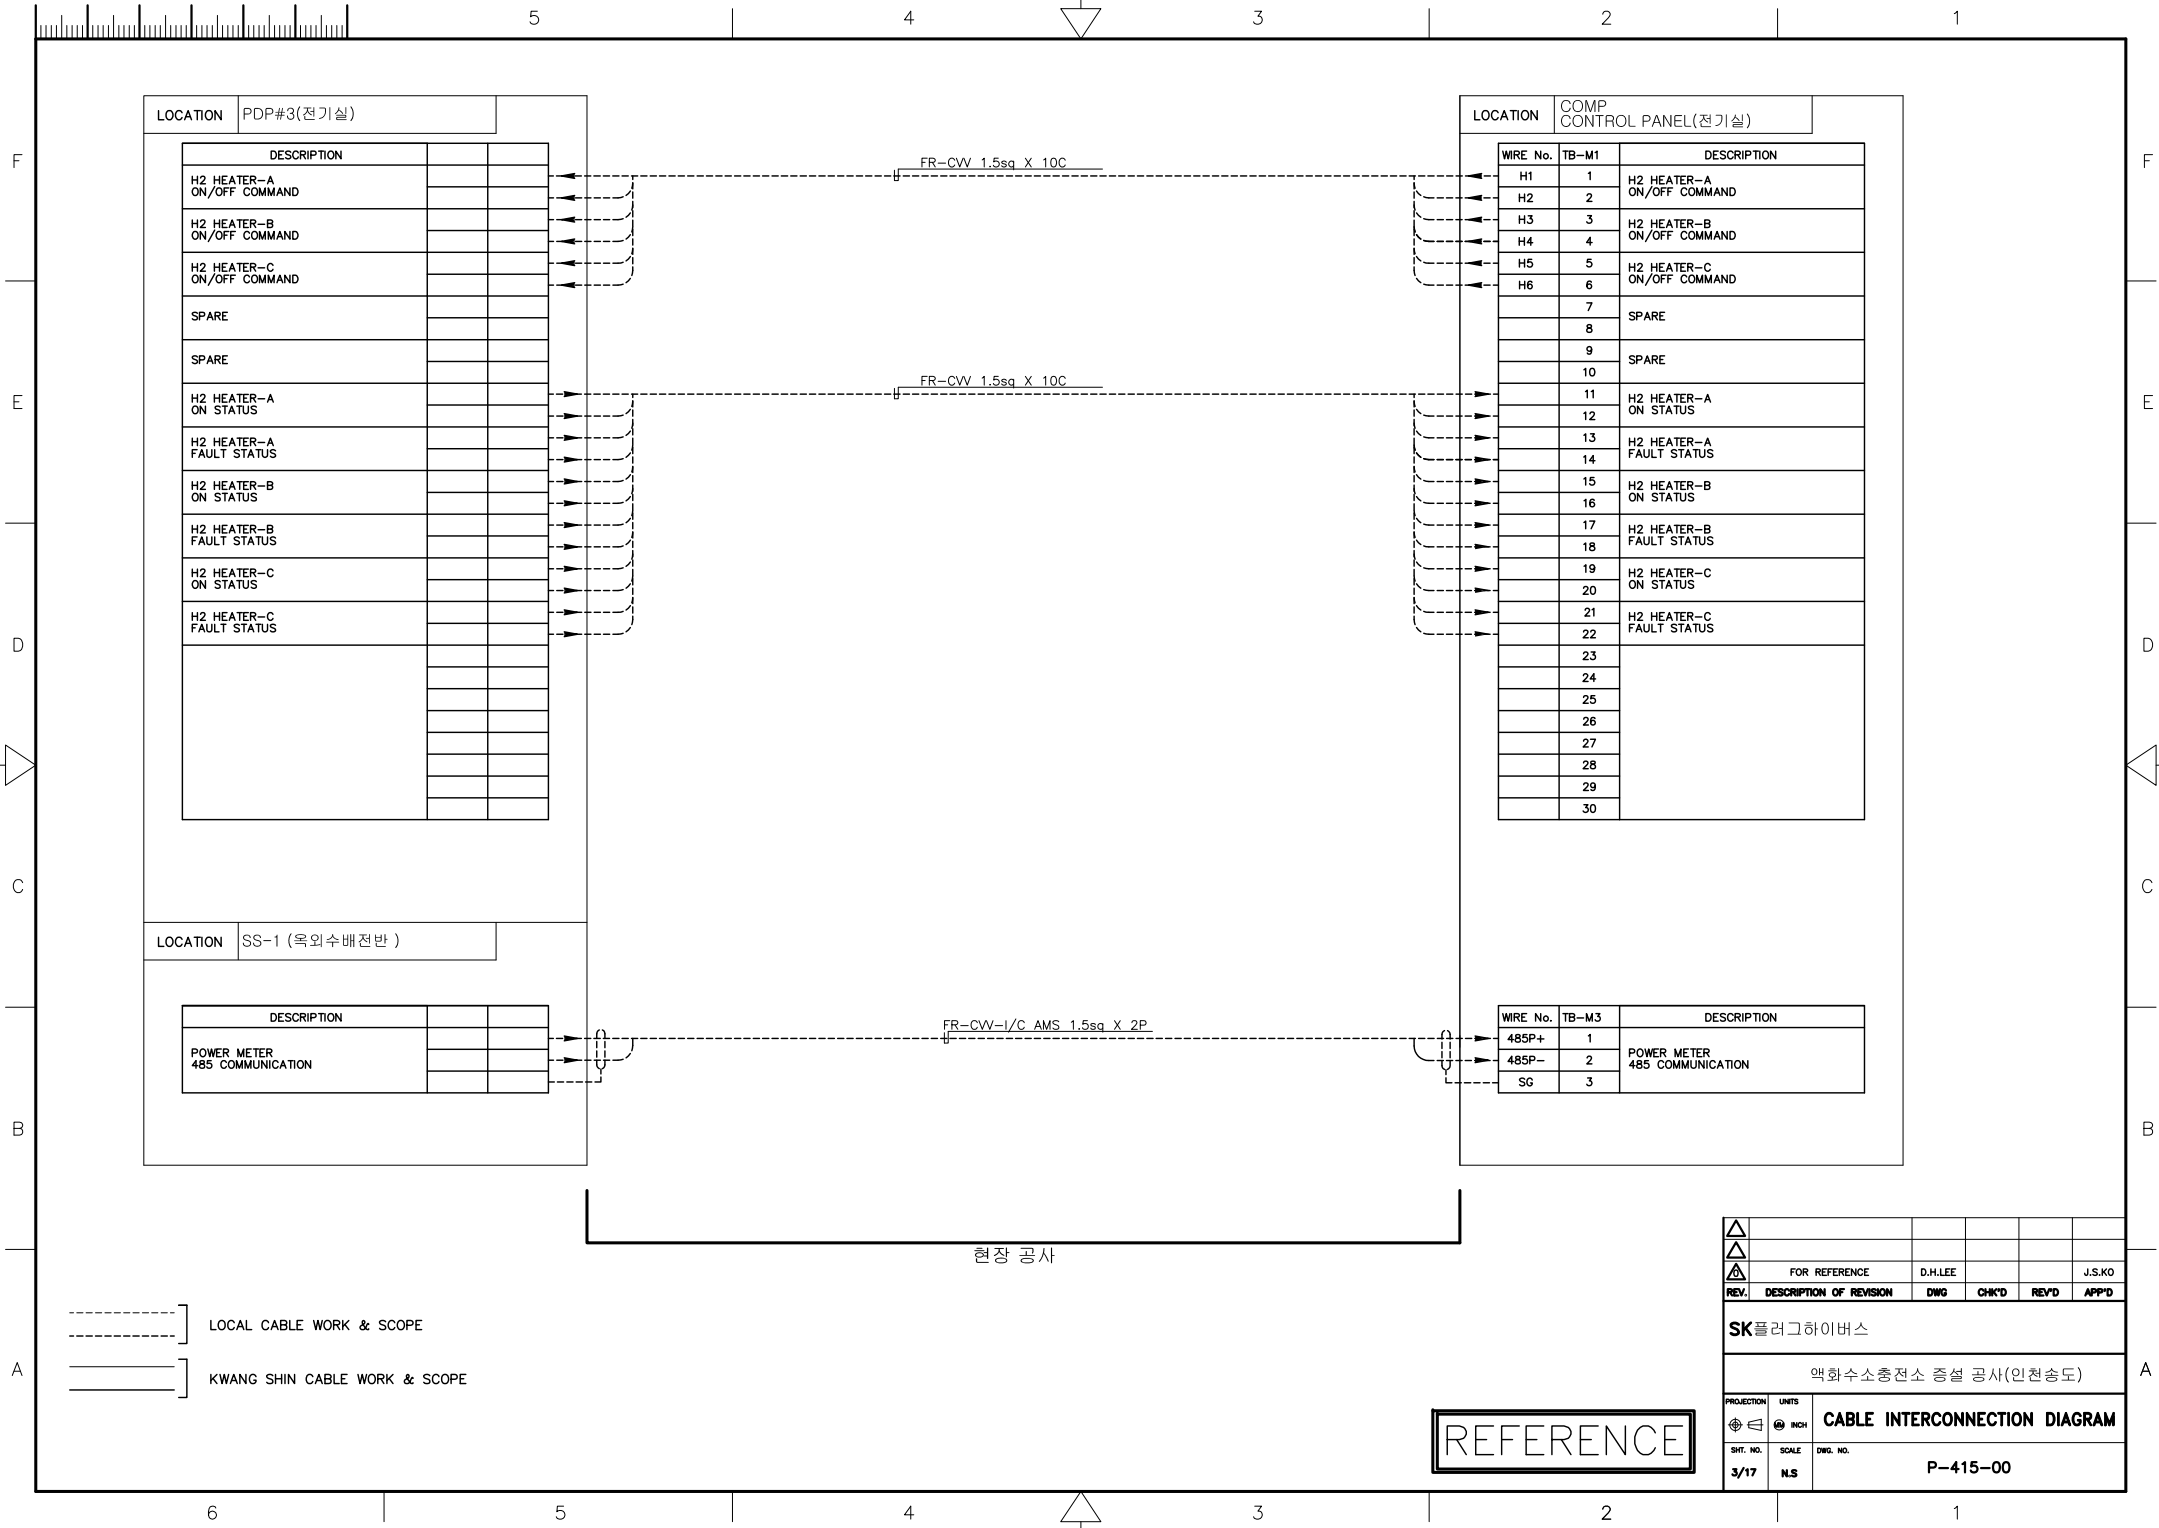

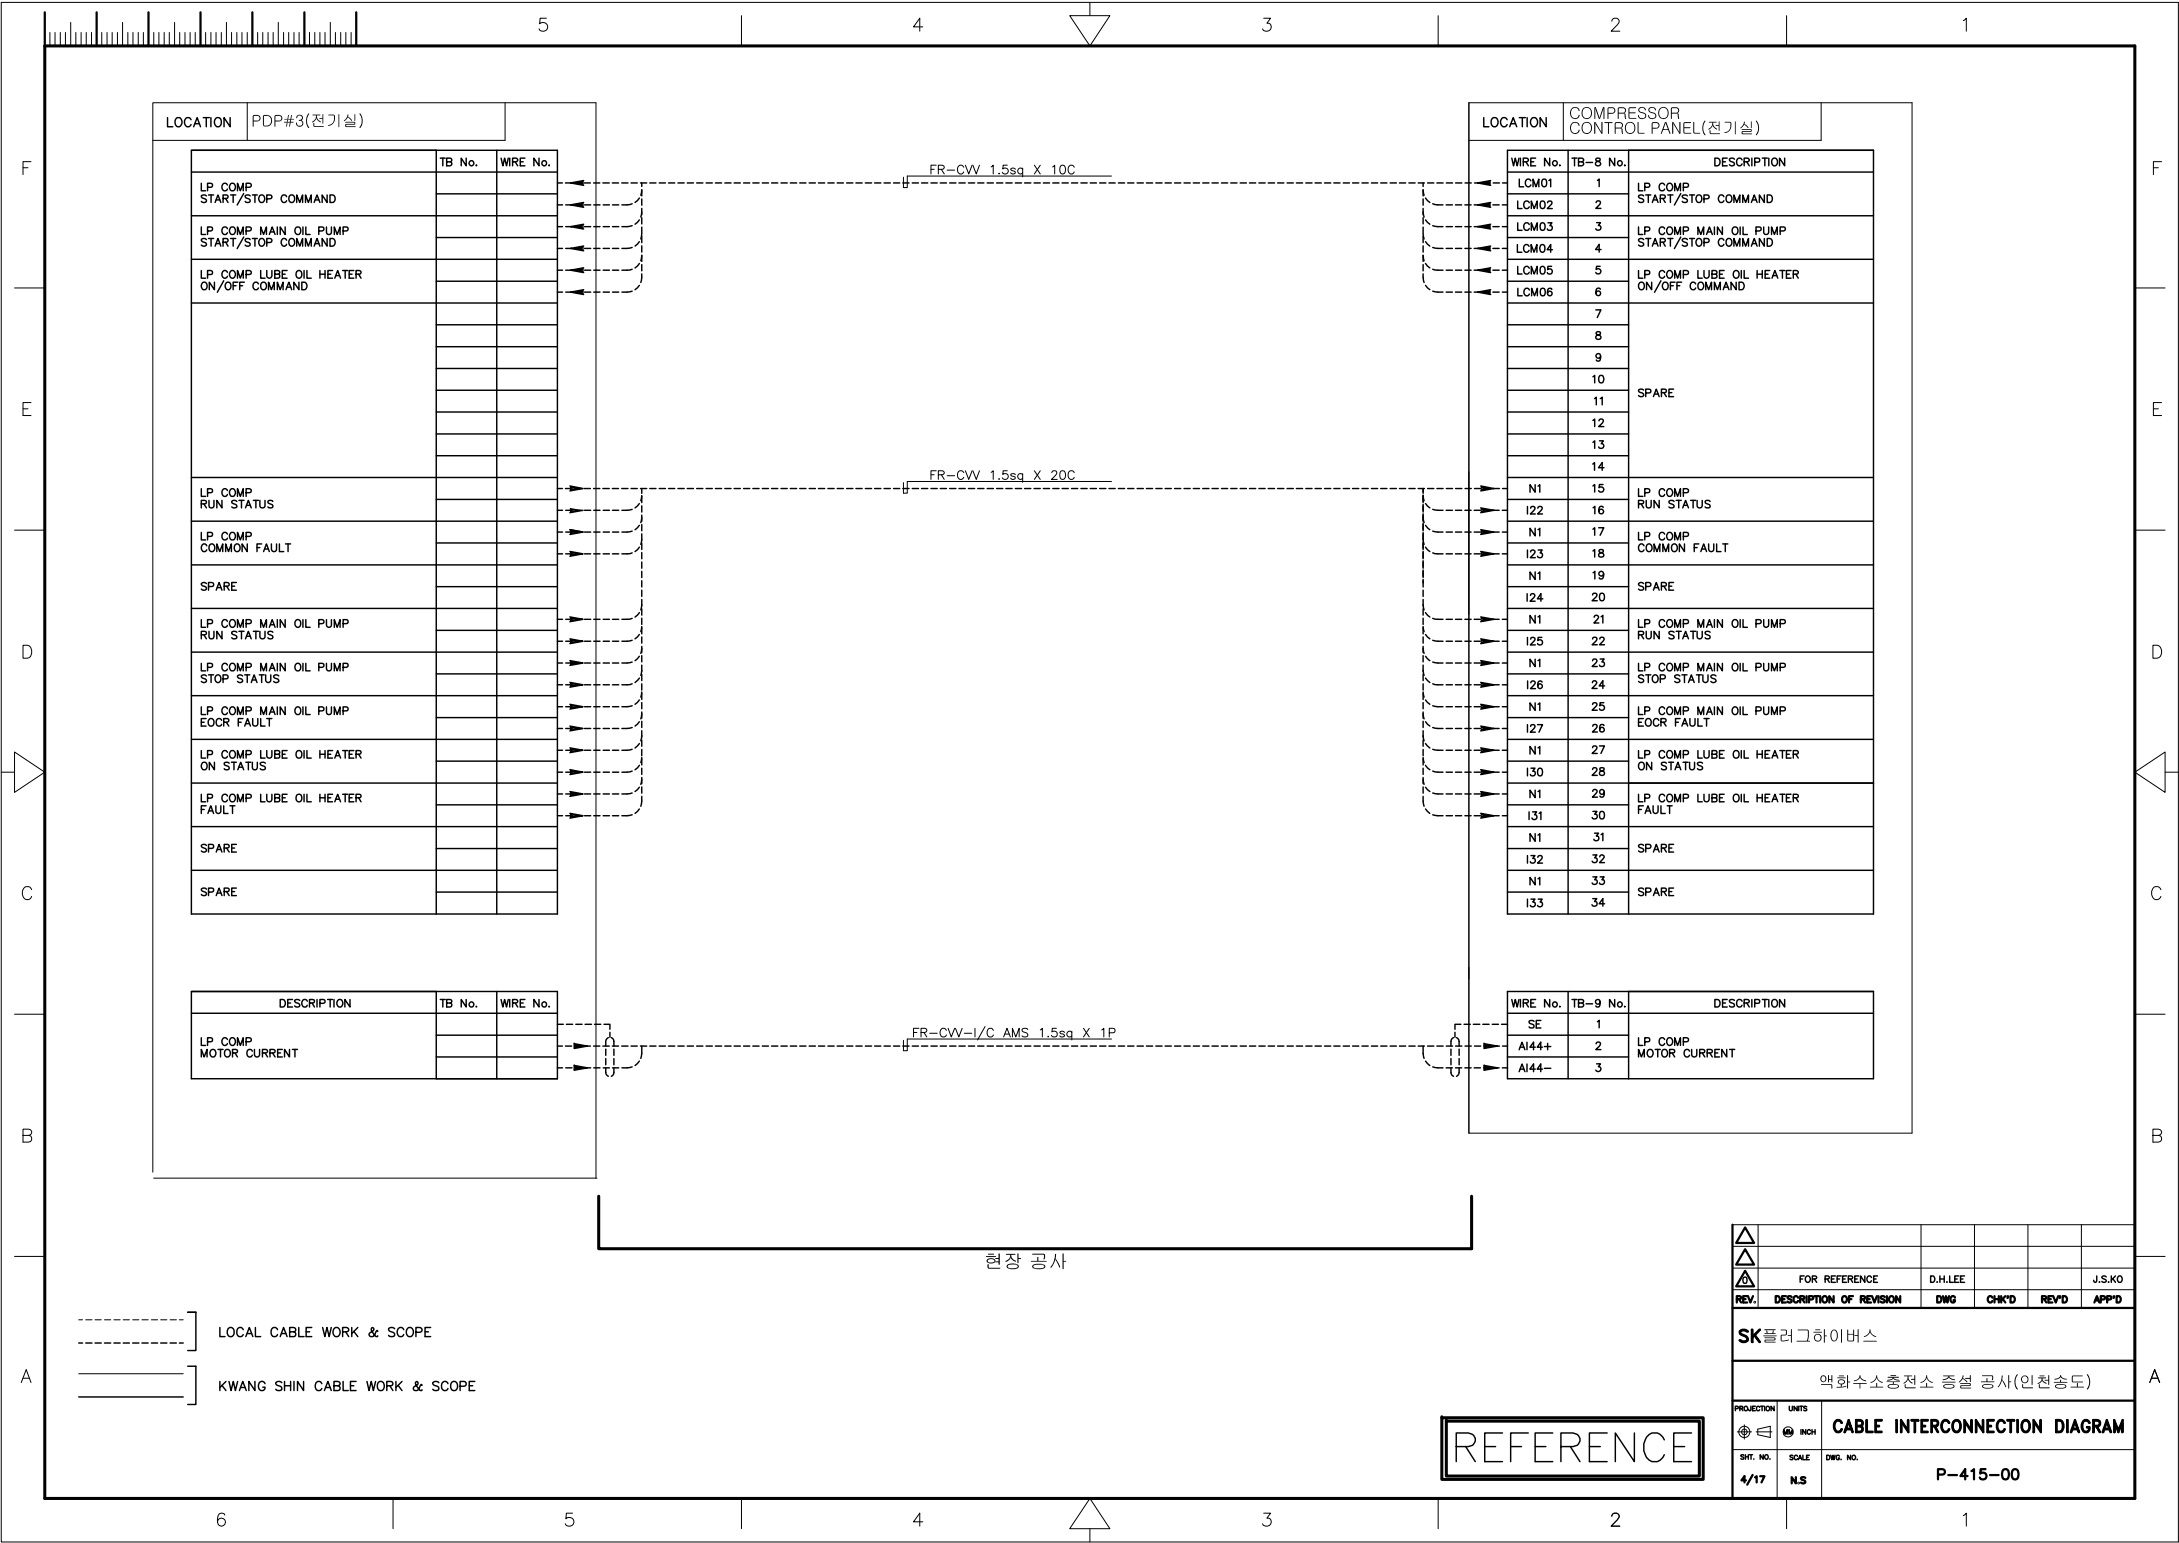

LOCATION PDP#3(전기실)

	TB No.	WIRE No.
LP COMP START/STOP COMMAND		
LP COMP MAIN OIL PUMP START/STOP COMMAND		
LP COMP LUBE OIL HEATER ON/OFF COMMAND		
LP COMP RUN STATUS		
LP COMP COMMON FAULT		
SPARE		
LP COMP MAIN OIL PUMP RUN STATUS		
LP COMP MAIN OIL PUMP STOP STATUS		
LP COMP MAIN OIL PUMP EOCR FAULT		
LP COMP LUBE OIL HEATER ON STATUS		
LP COMP LUBE OIL HEATER FAULT		
SPARE		
SPARE		

DESCRIPTION	TB No.	WIRE No.
LP COMP MOTOR CURRENT		

LOCATION COMPRESSOR CONTROL PANEL(전기실)

WIRE No.	TB-8 No.	DESCRIPTION
LCM01	1	LP COMP START/STOP COMMAND
LCM02	2	
LCM03	3	LP COMP MAIN OIL PUMP START/STOP COMMAND
LCM04	4	
LCM05	5	LP COMP LUBE OIL HEATER ON/OFF COMMAND
LCM06	6	
	7	
	8	
	9	
	10	
	11	SPARE
	12	
	13	
	14	
N1	15	LP COMP RUN STATUS
I22	16	
N1	17	LP COMP COMMON FAULT
I23	18	
N1	19	SPARE
I24	20	
N1	21	LP COMP MAIN OIL PUMP RUN STATUS
I25	22	
N1	23	LP COMP MAIN OIL PUMP STOP STATUS
I26	24	
N1	25	LP COMP MAIN OIL PUMP EOCR FAULT
I27	26	
N1	27	LP COMP LUBE OIL HEATER ON STATUS
I30	28	
N1	29	LP COMP LUBE OIL HEATER FAULT
I31	30	
N1	31	SPARE
I32	32	
N1	33	SPARE
I33	34	


WIRE No.	TB-9 No.	DESCRIPTION
SE	1	
A144+	2	LP COMP MOTOR CURRENT
A144-	3	


LOCAL CABLE WORK & SCOPE

KWANG SHIN CABLE WORK & SCOPE

REFERENCE

△					
△					
REV.	FOR REFERENCE	D.H.LEE			J.S.KO
	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이버스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
SHT. NO.	SCALE	DWG. NO.			
4/17	N.S	P-415-00			

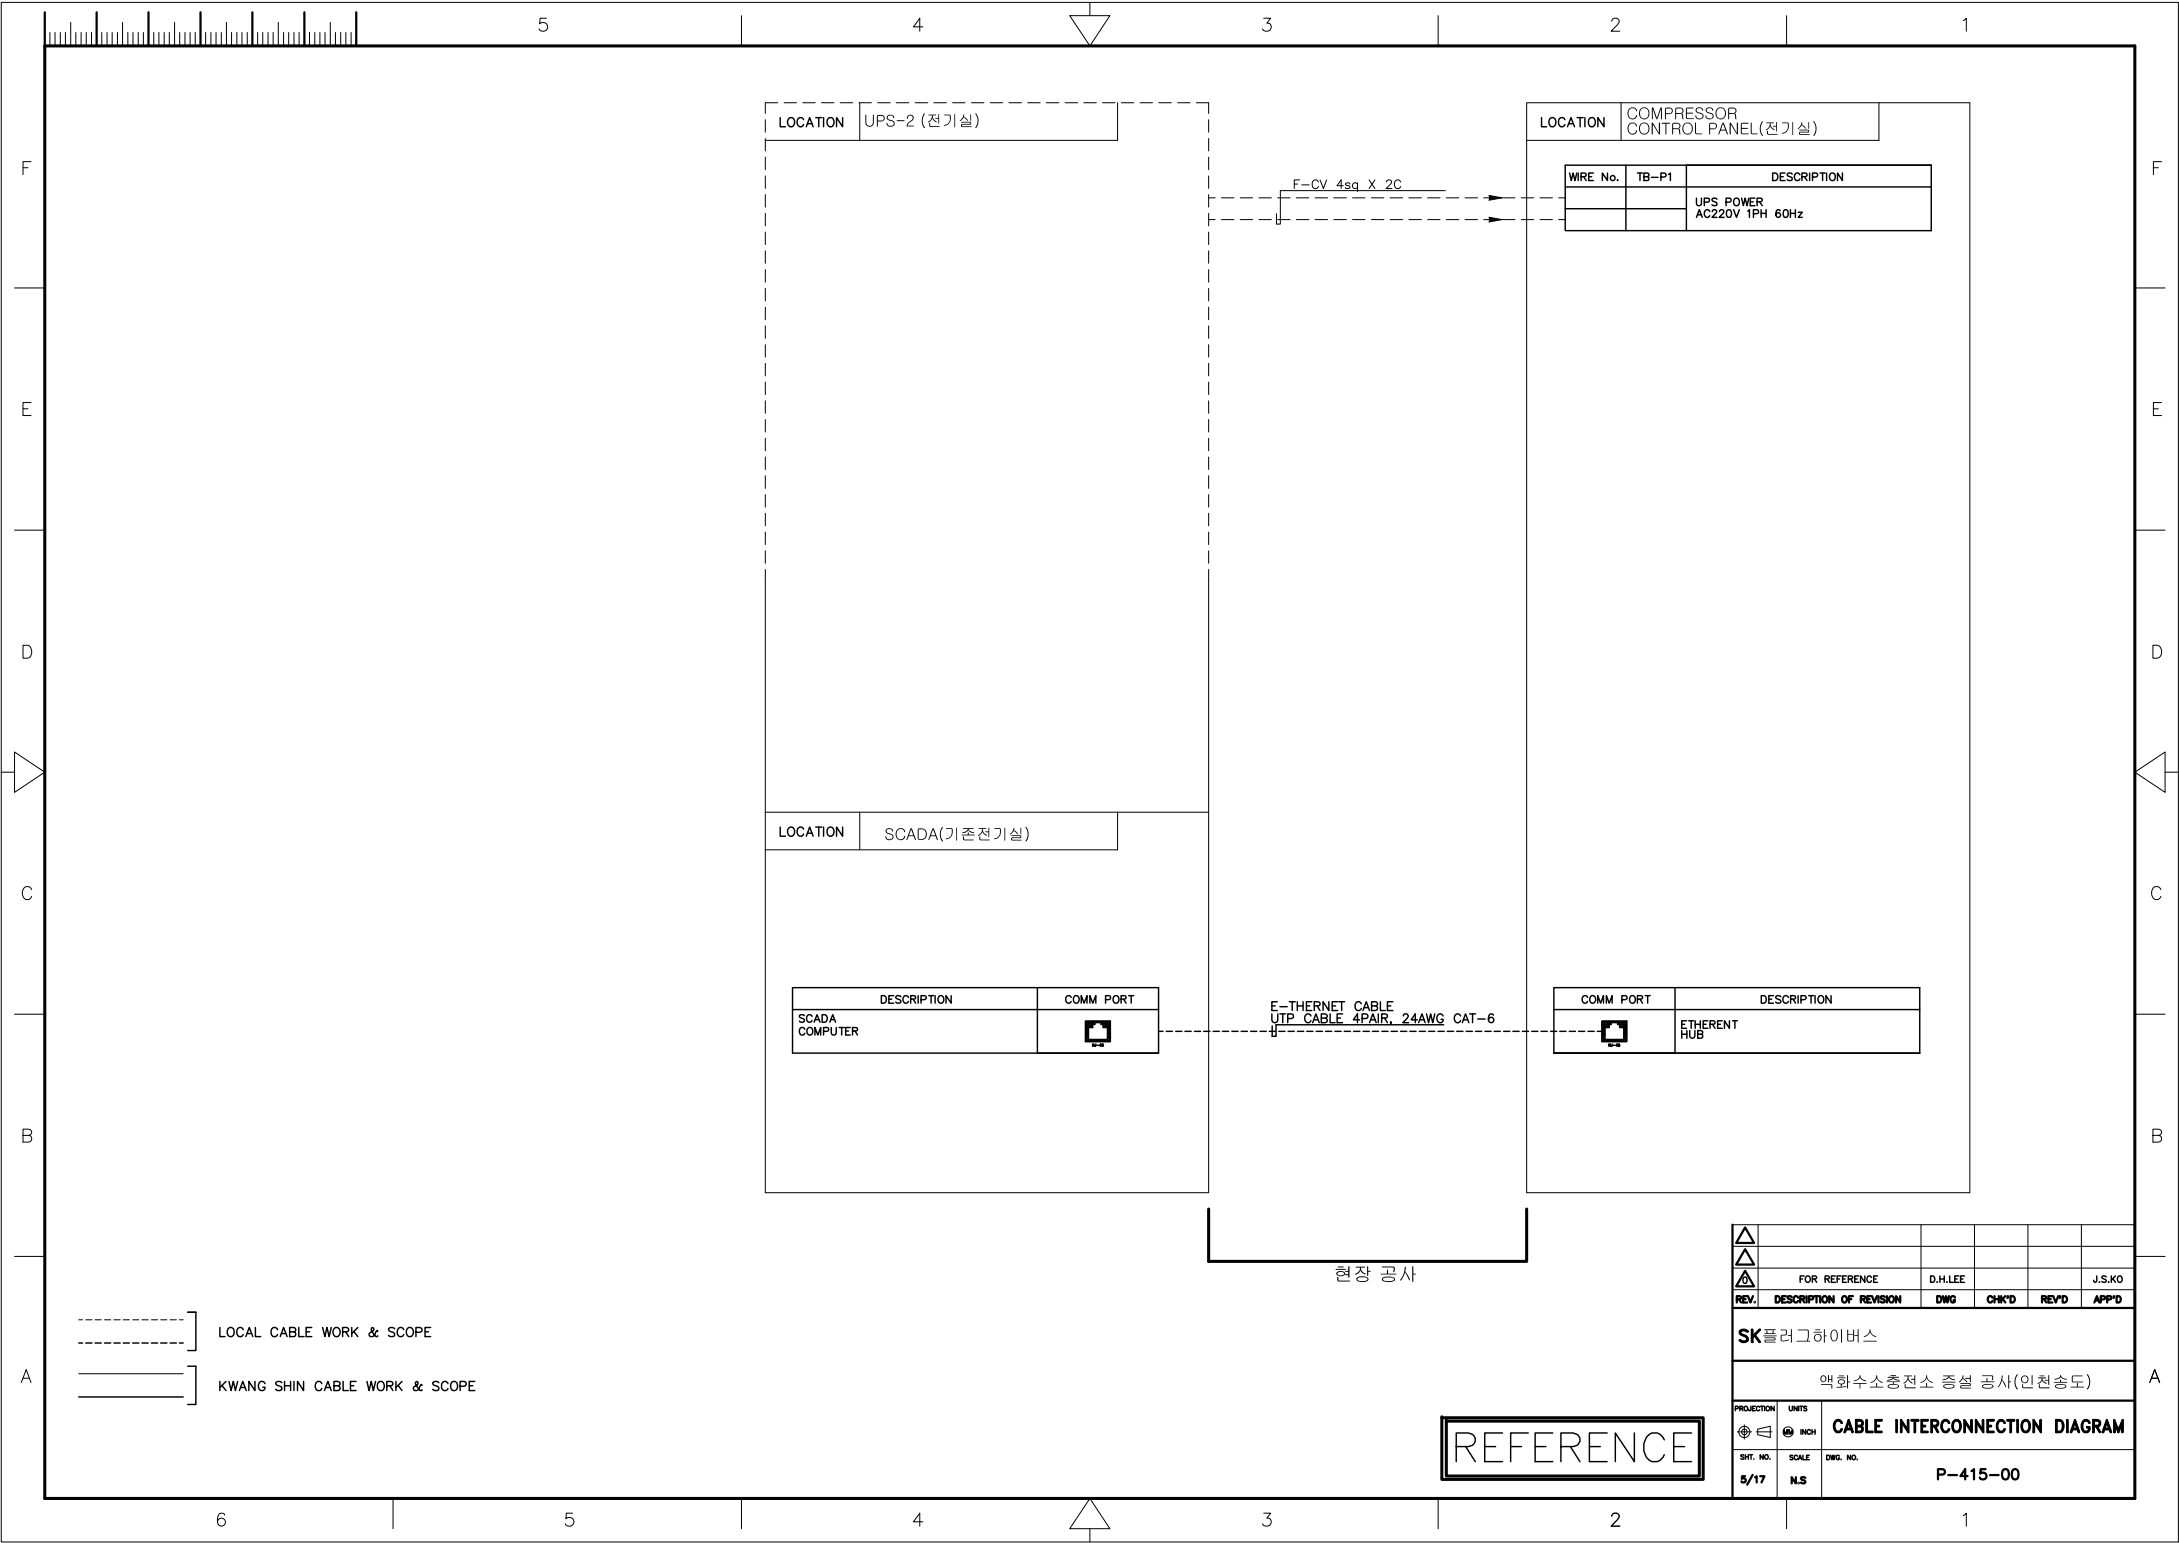

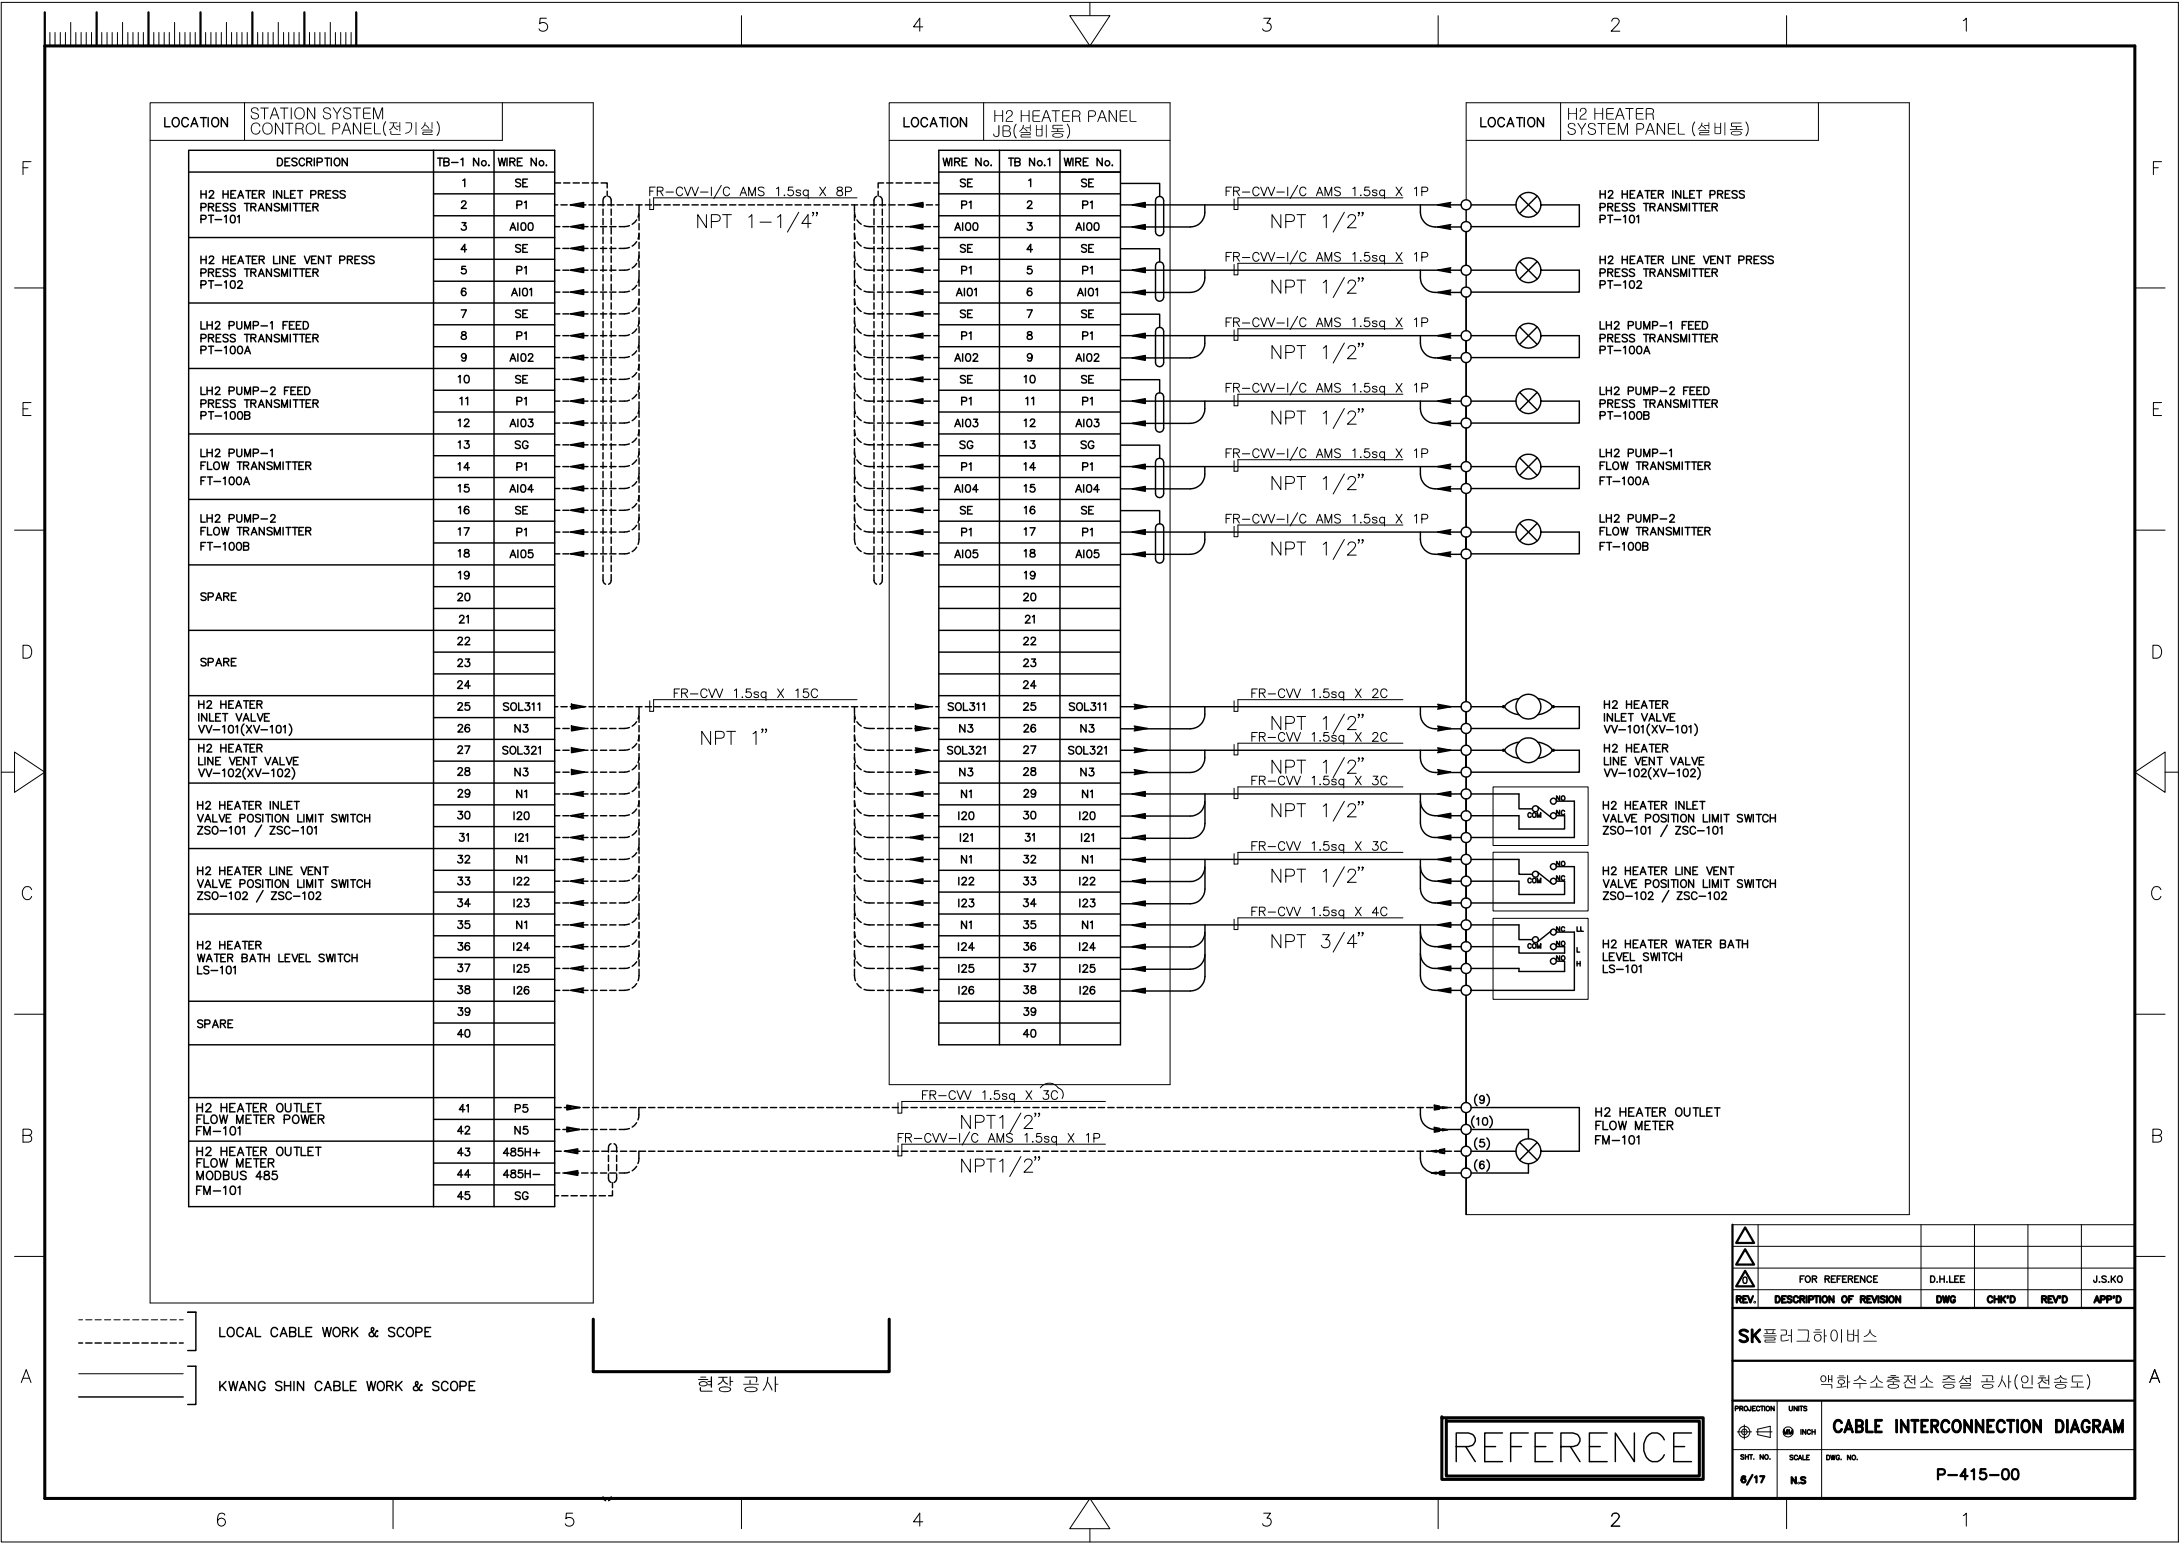


LOCATION STATION SYSTEM
CONTROL PANEL(전기실)

DESCRIPTION	TB-1 No.	WIRE No.
H2 HEATER INLET PRESS PRESS. TRANSMITTER PT-101	1	SE
	2	P1
	3	AI00
H2 HEATER LINE VENT PRESS PRESS. TRANSMITTER PT-102	4	SE
	5	P1
	6	AI01
LH2 PUMP-1 FEED PRESS. TRANSMITTER PT-100A	7	SE
	8	P1
	9	AI02
LH2 PUMP-2 FEED PRESS. TRANSMITTER PT-100B	10	SE
	11	P1
	12	AI03
LH2 PUMP-1 FLOW TRANSMITTER FT-100A	13	SG
	14	P1
	15	AI04
LH2 PUMP-2 FLOW TRANSMITTER FT-100B	16	SE
	17	P1
	18	AI05
SPARE	19	
	20	
	21	
	22	
SPARE	23	
	24	
H2 HEATER INLET VALVE VV-101(XV-101)	25	SOL311
	26	N3
H2 HEATER LINE VENT VALVE VV-102(XV-102)	27	SOL321
	28	N3
H2 HEATER INLET VALVE POSITION LIMIT SWITCH ZSO-101 / ZSC-101	29	N1
	30	I20
	31	I21
H2 HEATER LINE VENT VALVE POSITION LIMIT SWITCH ZSO-102 / ZSC-102	32	N1
	33	I22
	34	I23
H2 HEATER WATER BATH LEVEL SWITCH LS-101	35	N1
	36	I24
	37	I25
	38	I26
SPARE	39	
	40	
H2 HEATER OUTLET FLOW METER POWER FM-101	41	P5
	42	N5
H2 HEATER OUTLET FLOW METER MODBUS 485 FM-101	43	485H+
	44	485H-
	45	SG

LOCATION H2 HEATER PANEL
JB(설비동)

WIRE No.	TB No.1	WIRE No.
SE	1	SE
P1	2	P1
AI00	3	AI00
SE	4	SE
P1	5	P1
AI01	6	AI01
SE	7	SE
P1	8	P1
AI02	9	AI02
SE	10	SE
P1	11	P1
AI03	12	AI03
SG	13	SG
P1	14	P1
AI04	15	AI04
SE	16	SE
P1	17	P1
AI05	18	AI05
	19	
	20	
	21	
	22	
	23	
	24	
SOL311	25	SOL311
N3	26	N3
SOL321	27	SOL321
N3	28	N3
N1	29	N1
I20	30	I20
I21	31	I21
N1	32	N1
I22	33	I22
I23	34	I23
N1	35	N1
I24	36	I24
I25	37	I25
I26	38	I26
	39	
	40	

LOCATION H2 HEATER
SYSTEM PANEL (설비동)

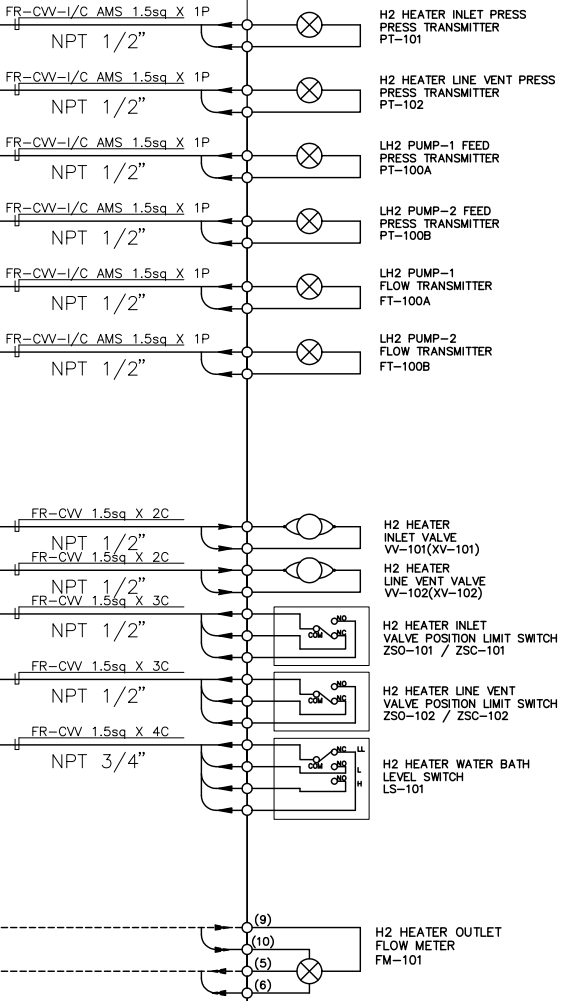

LOCAL CABLE WORK & SCOPE

KWANG SHIN CABLE WORK & SCOPE

현장 공사

REFERENCE

					
					
	FOR REFERENCE	D.H.LEE			J.S.KO
REV.	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이버스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
	 INCH	P-415-00			
SHT. NO.	SCALE				
6/17	N.S				

LOCATION COMPRESSOR
CONTROL PANEL(전기실)

DESCRIPTION	TB-2S No.	WIRE No.
H2 HEATER INLET TEMP TRANSMITTER TT-101	1	SE
	2	AI10+S
	3	AI10-S
H2 HEATER LINE VENT TEMP TRANSMITTER TT-102	4	SE
	5	AI11+S
	6	AI11-S
LH2 PUMP-1 FEED TEMP TRANSMITTER TT-100A	7	SE
	8	AI12+S
	9	AI12-S
LH2 PUMP-2 FEED TEMP TRANSMITTER TT-100B	10	SE
	11	AI13+S
	12	AI13-S
SPARE	13	
	14	
	15	



DESCRIPTION	TB-3 No.	WIRE No.
WATER BATH TEMP TRANSMITTER TT-103A	1	SE
	2	P1
	3	AI14
WATER BATH TEMP TRANSMITTER TT-103B	4	SE
	5	P1
	6	AI15
WATER BATH TEMP TRANSMITTER TT-103C	7	SE
	8	P1
	9	AI16

LOCATION H2 HEATER PANEL
JB(설비동)

WIRE No.	TB No.2S	WIRE No.
SE	1	SE
AI10+S	2	AI10+S
AI10-S	3	AI10-S
SE	4	SE
AI11+S	5	AI11+S
AI11-S	6	AI11-S
SE	7	SE
AI12+S	8	AI12+S
AI12-S	9	AI12-S
SE	10	SE
AI13+S	11	AI13+S
AI13-S	12	AI13-S
	13	
	14	
	15	

LOCATION H2 HEATER
SYSTEM PANEL (설비동)

*For cryogenic service, WIKA TE and TT are intergrated.

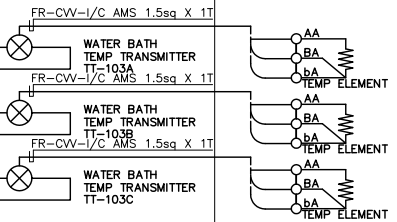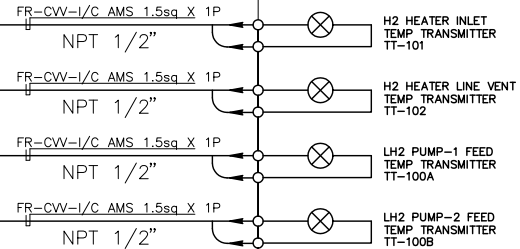

LOCATION H2 HEATER


LOCAL CABLE WORK & SCOPE


KWANG SHIN CABLE WORK & SCOPE


현장 공사


REFERENCE

△					
△					
REV.	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이버스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
SHT. NO.	SCALE	DWG. NO.	P-415-00		
7/17	N.S				

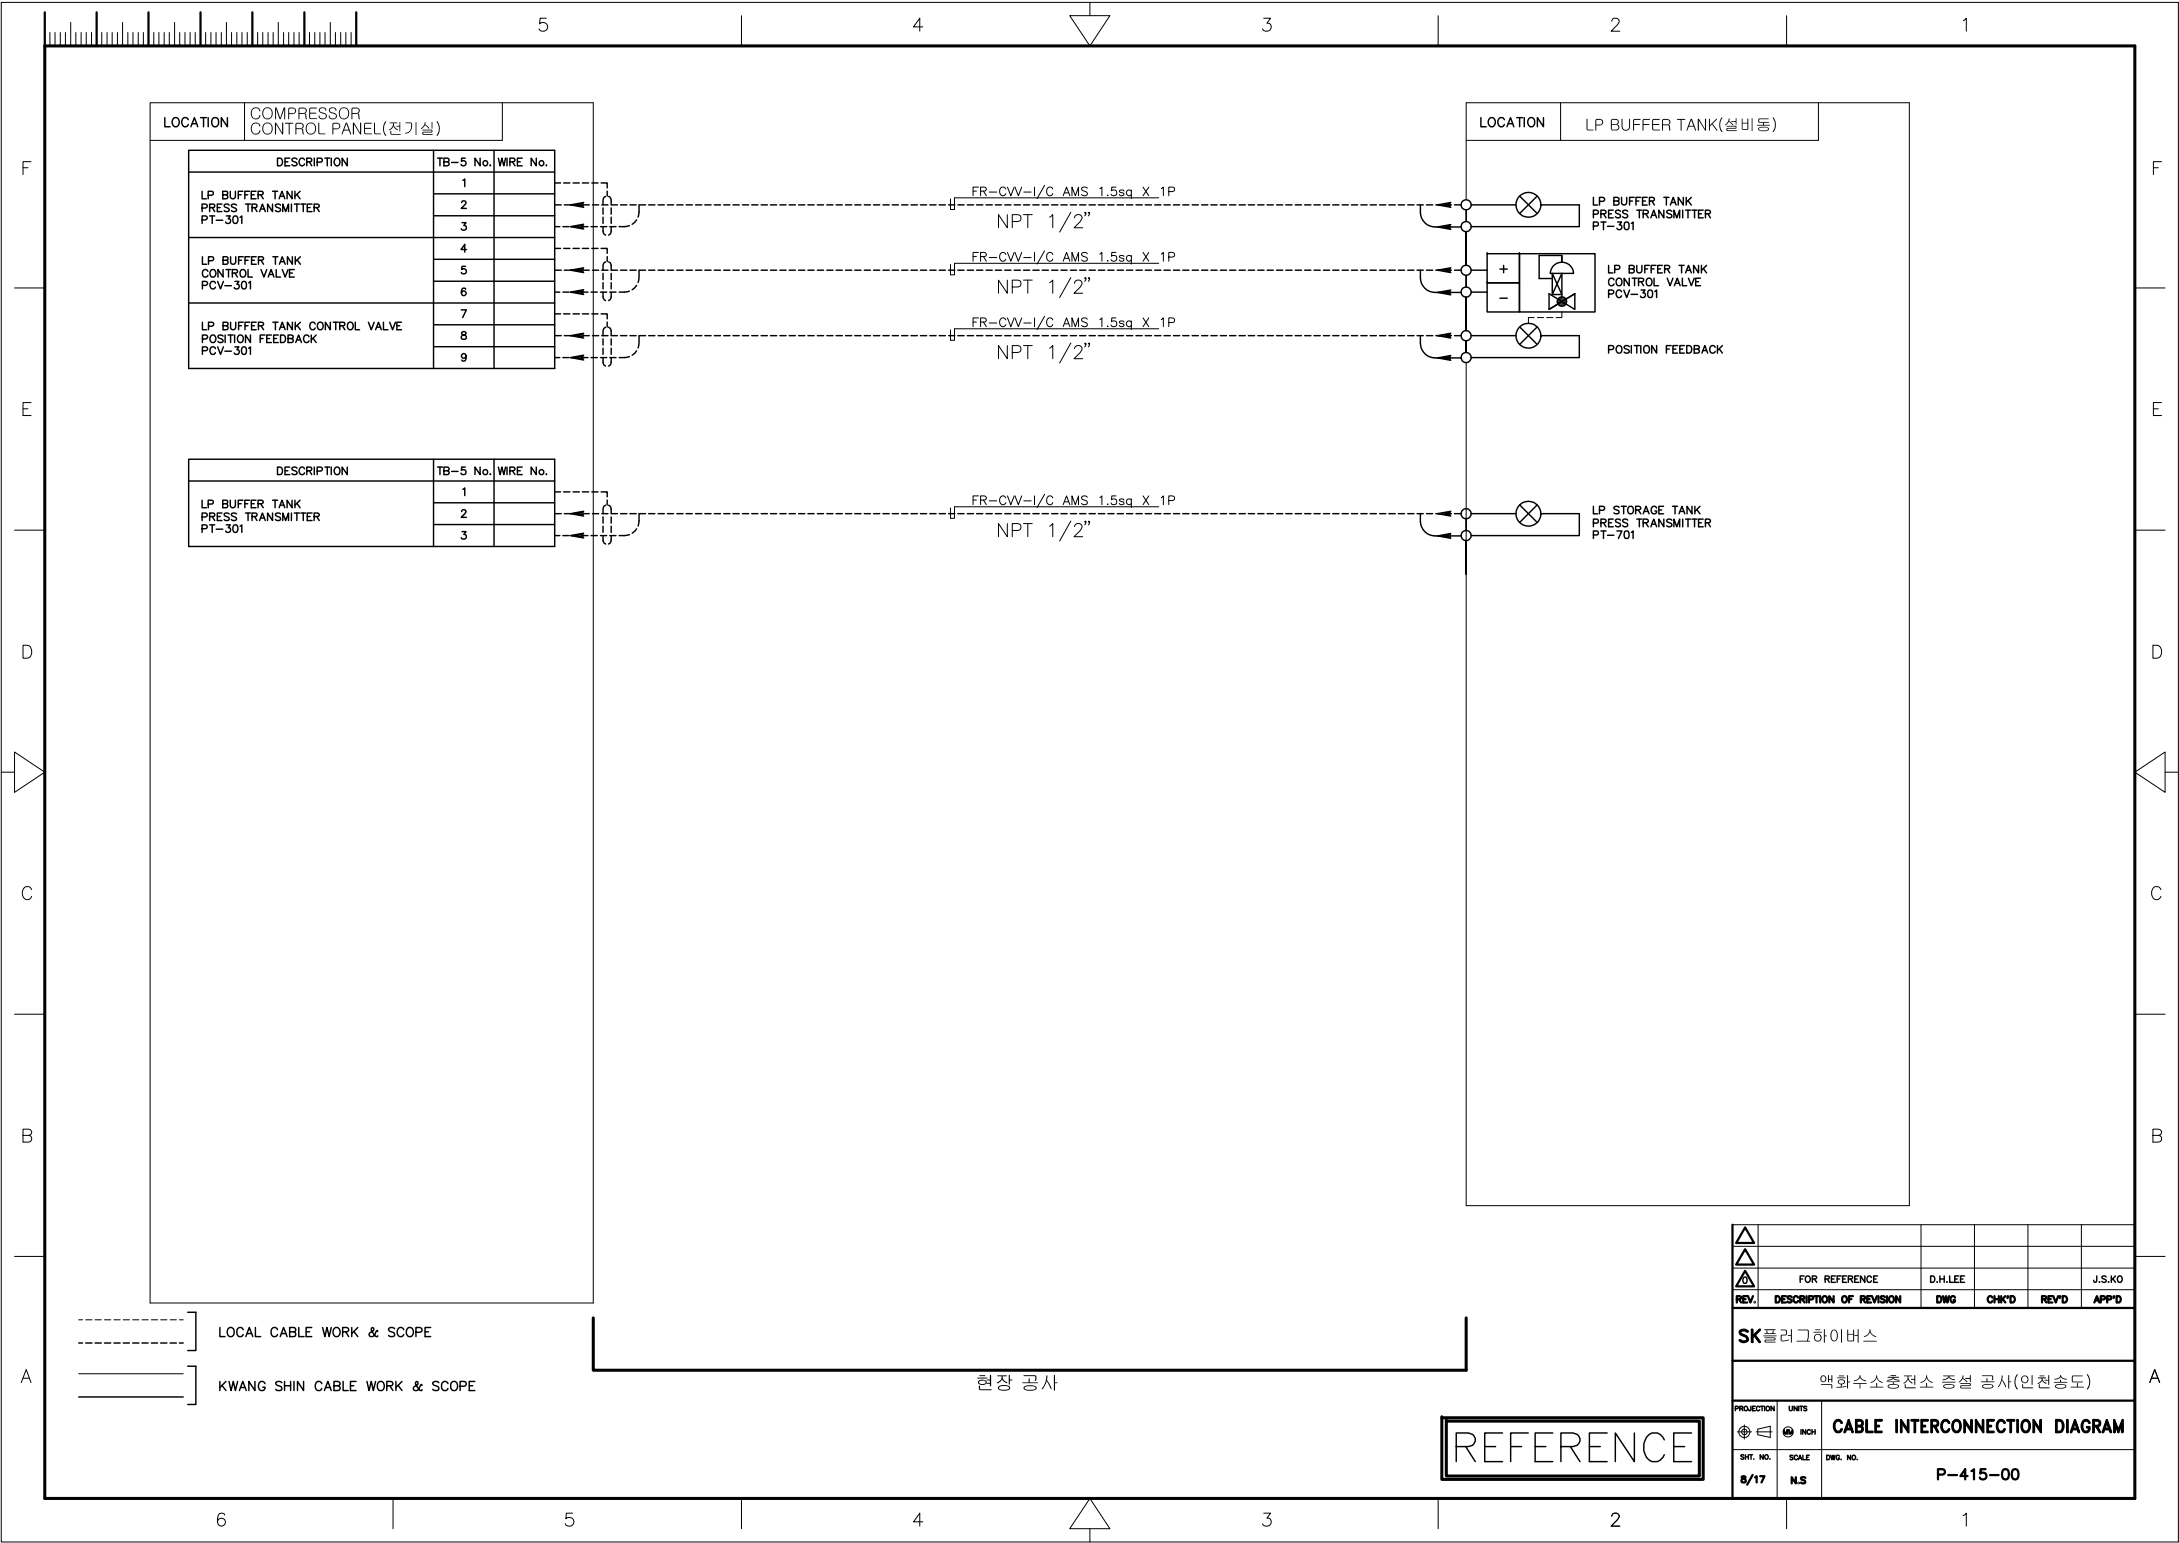

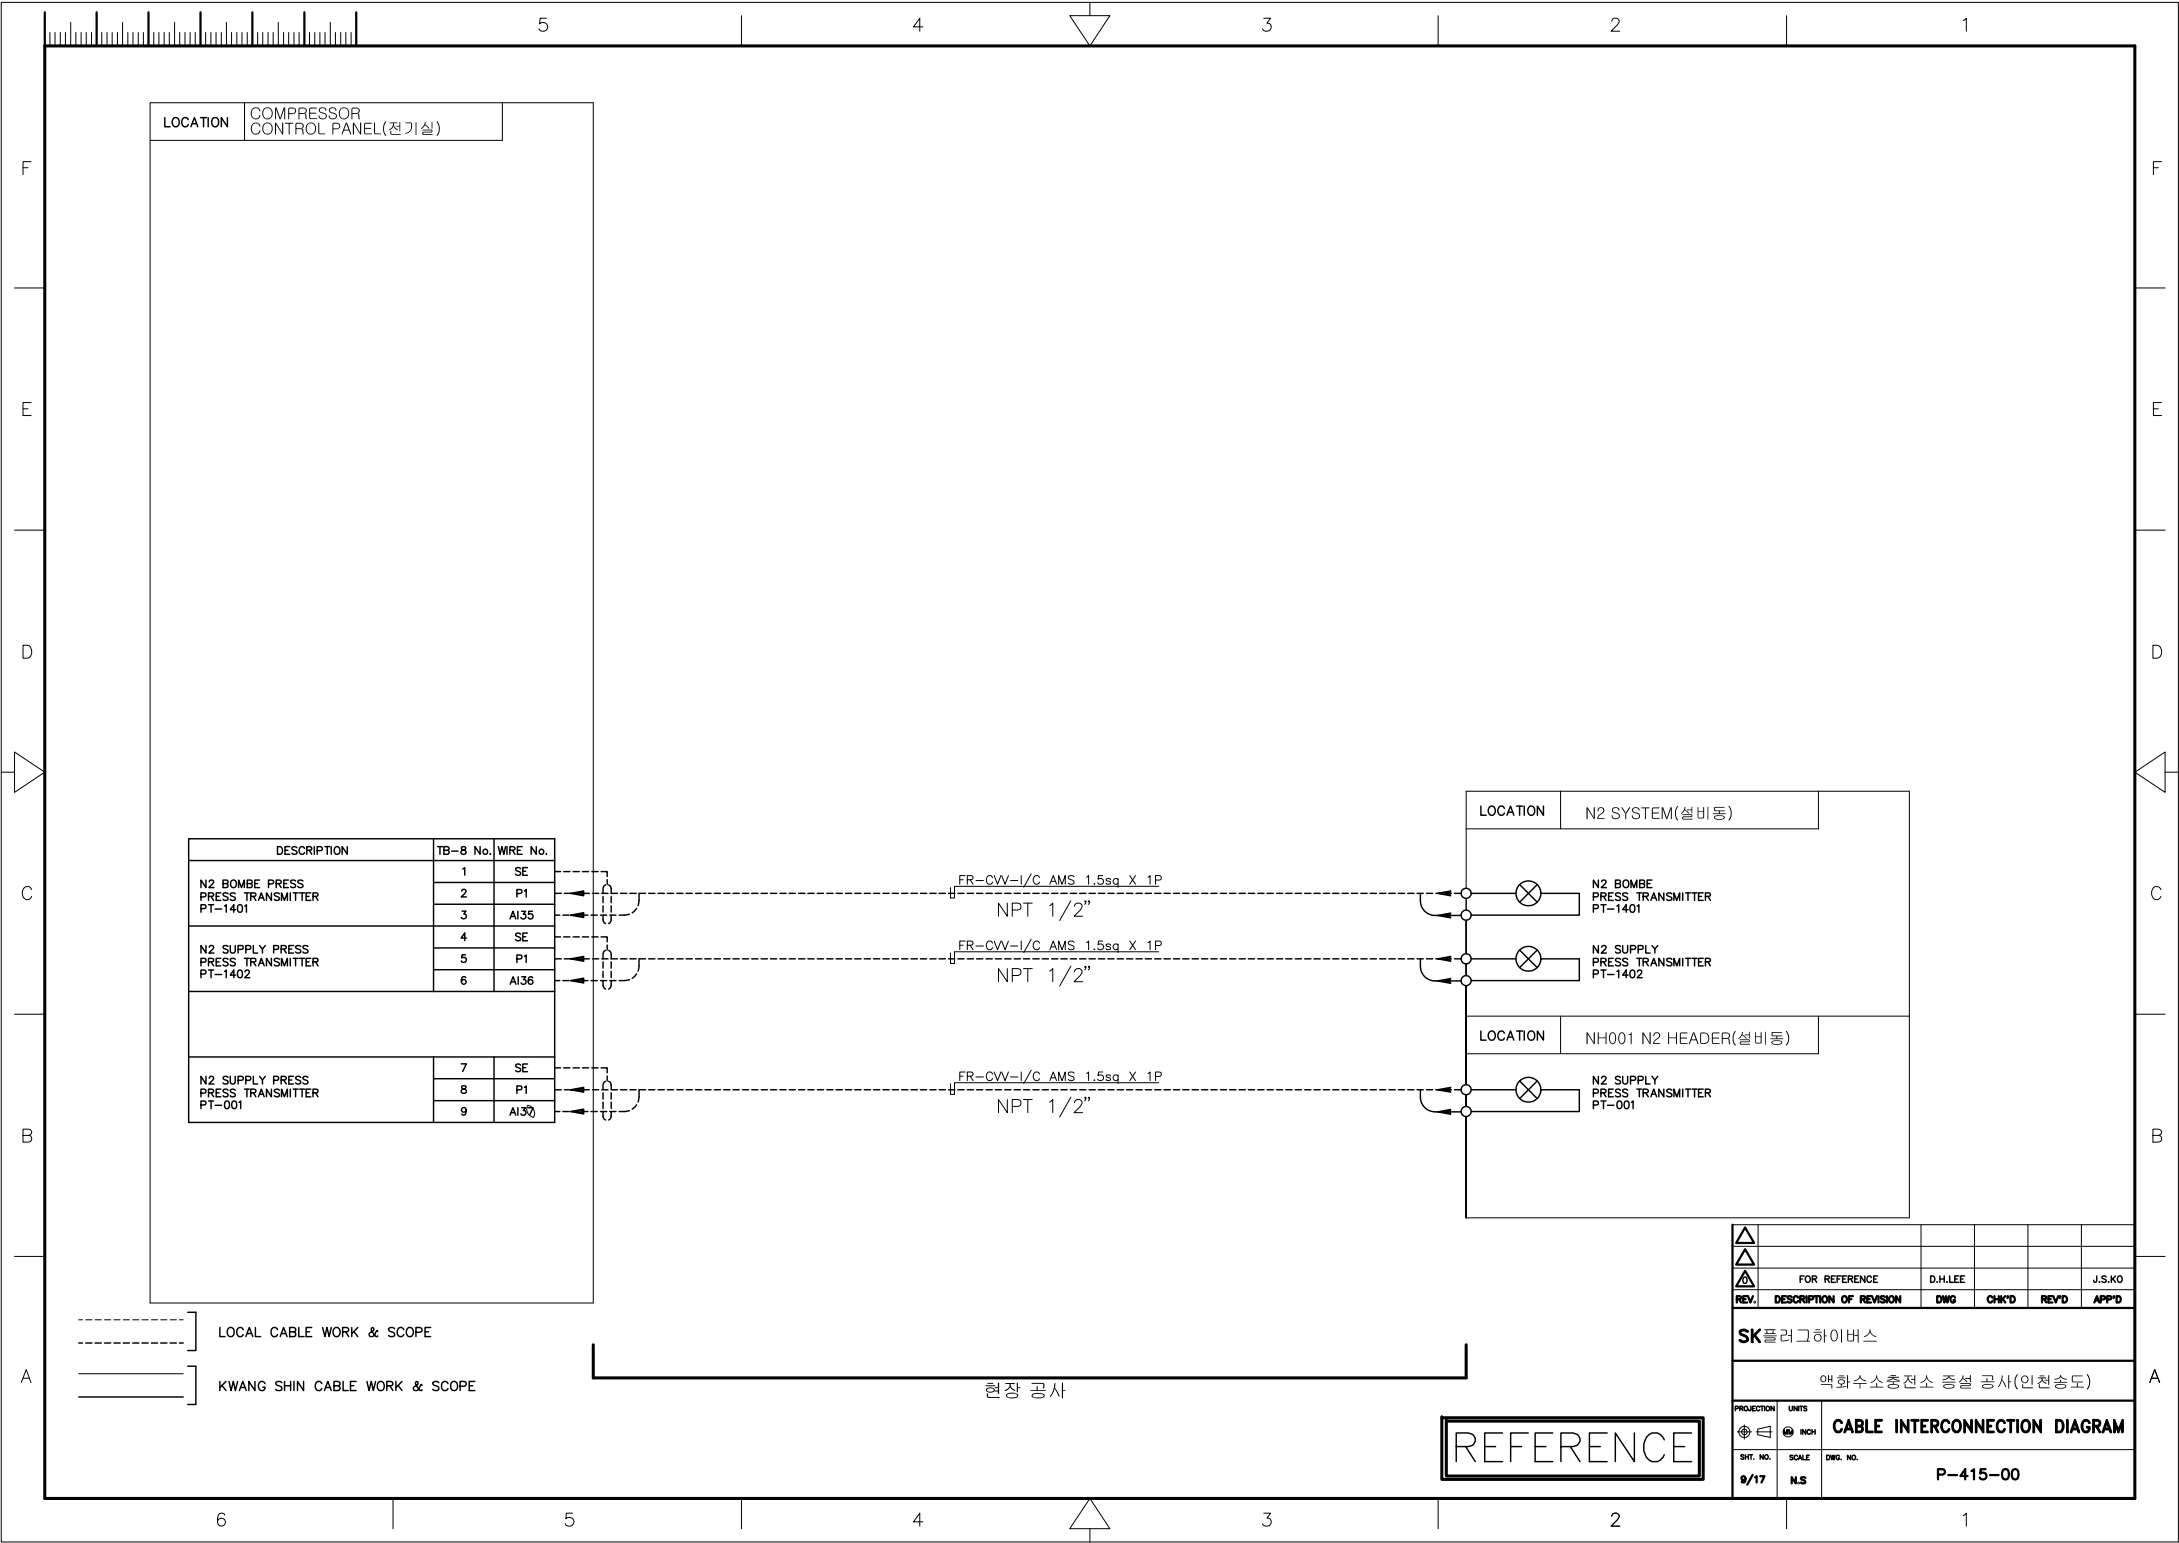

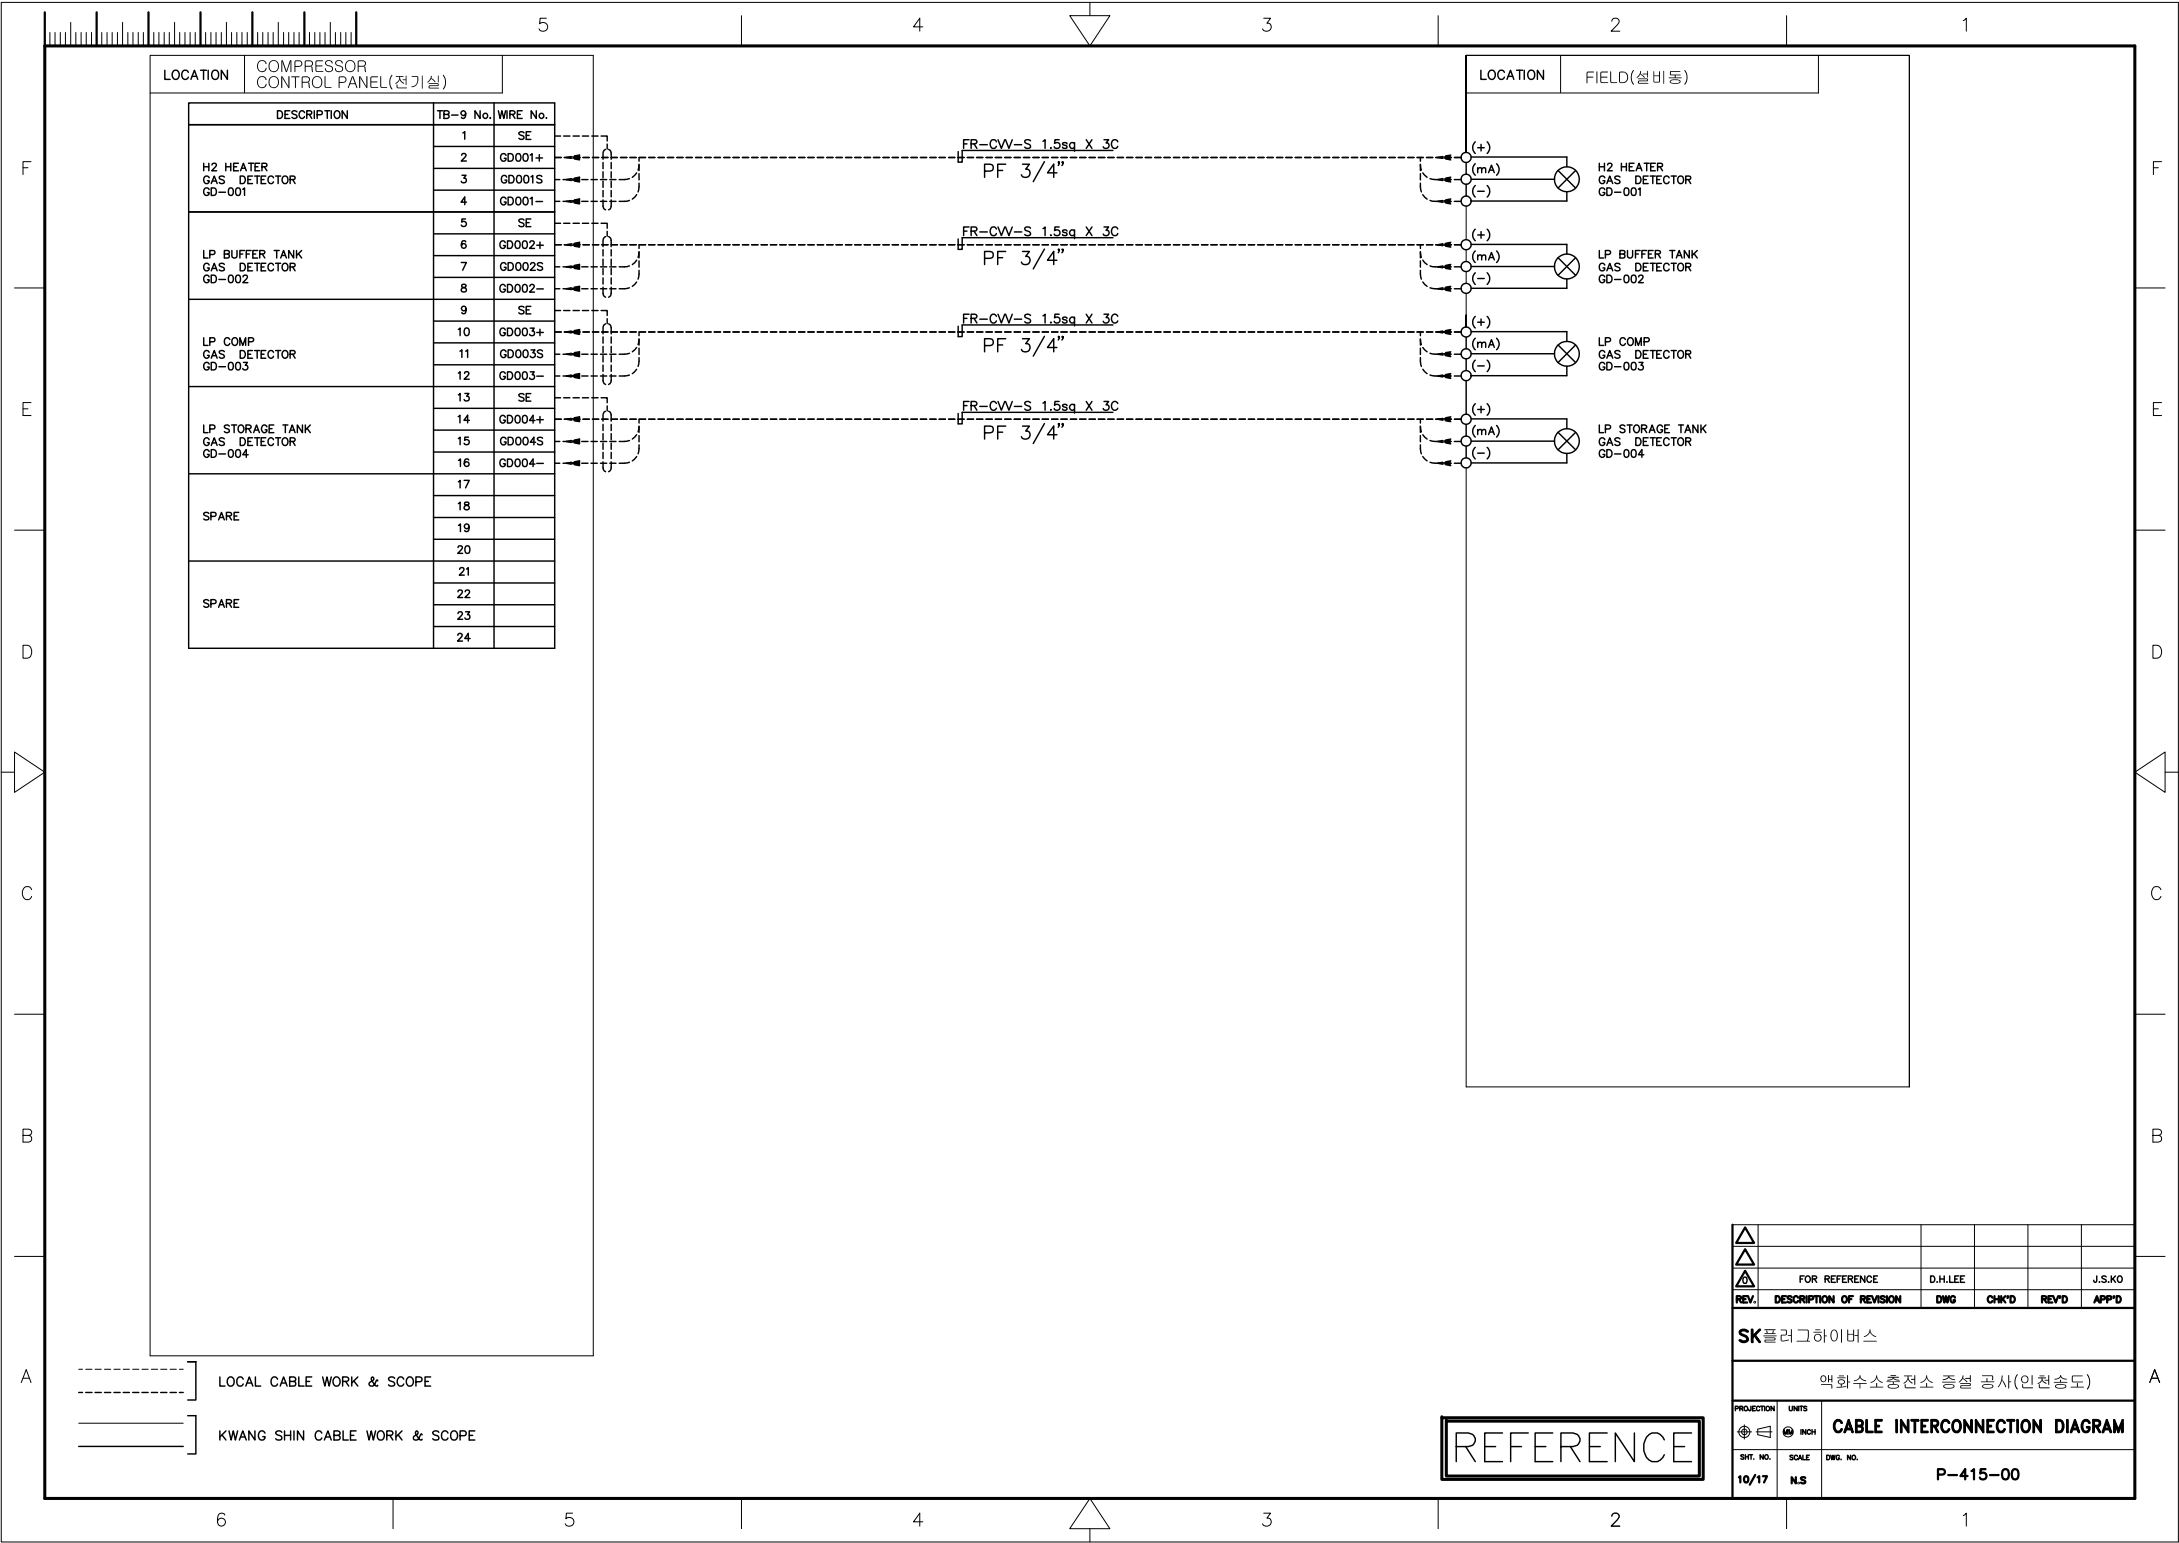

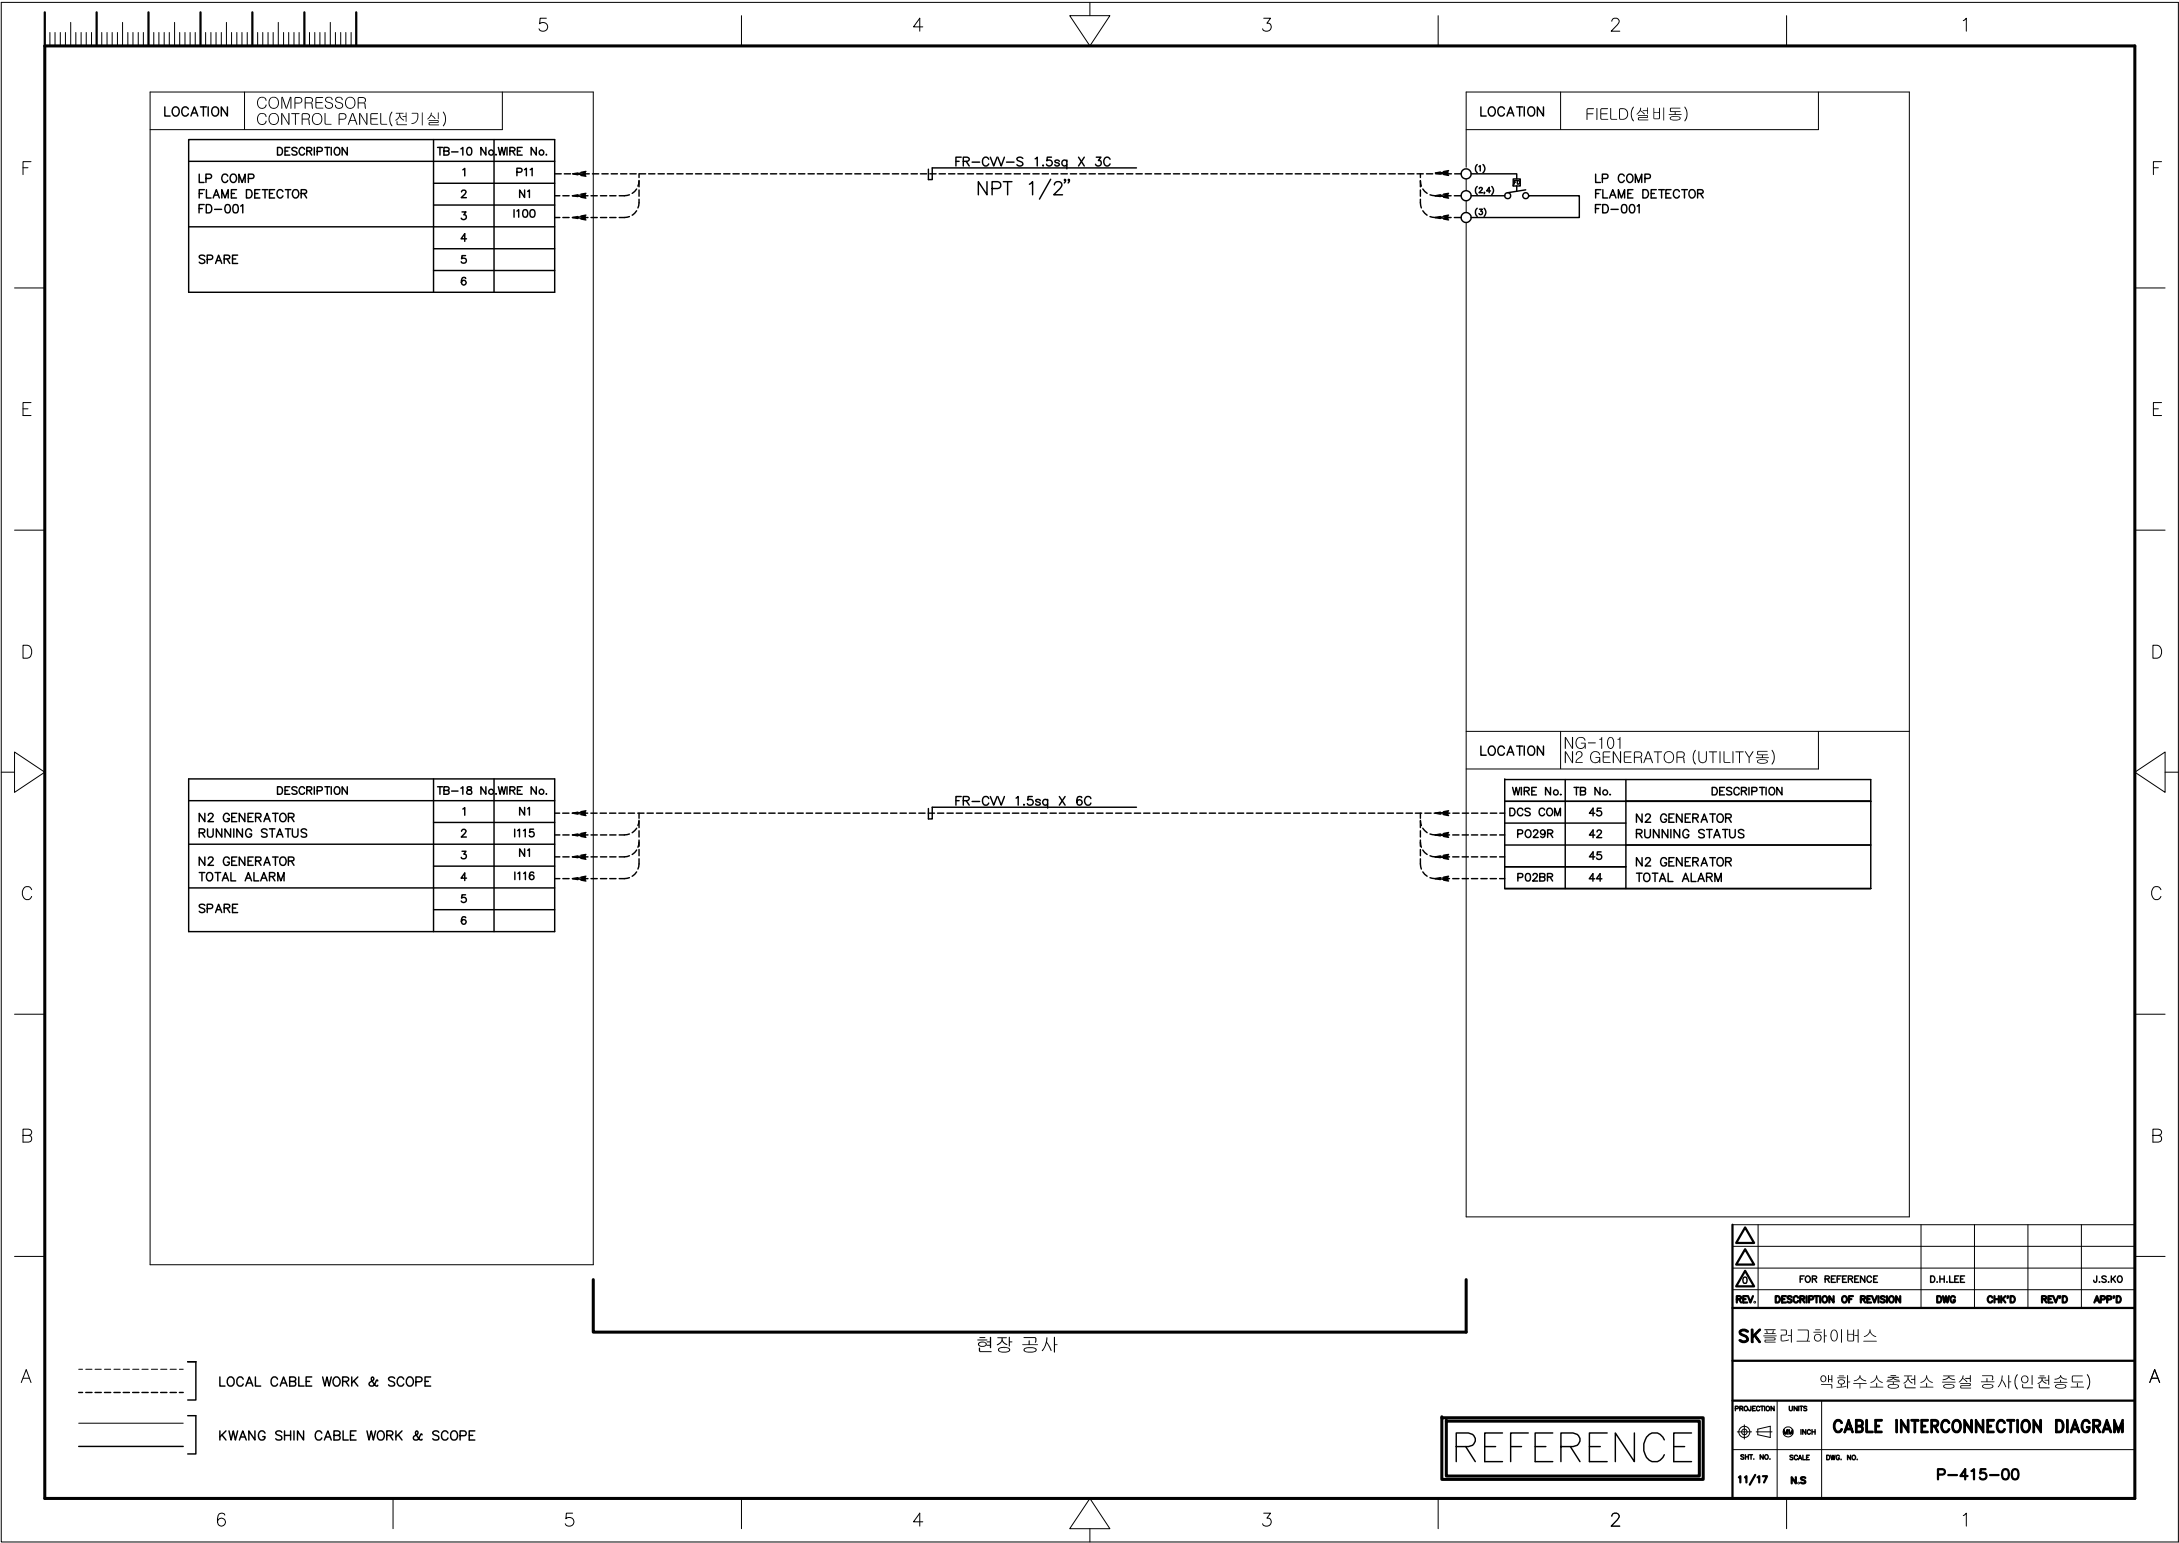

LOCATION			COMPRESSOR CONTROL PANEL(전기실)		
DESCRIPTION		TB-10 No.		WIRE No.	
LP COMP		1	P11		
FLAME DETECTOR		2	N1		
FD-001		3	I100		
SPARE		4			
		5			
		6			

DESCRIPTION		TB-18 No.		WIRE No.	
N2 GENERATOR		1	N1		
RUNNING STATUS		2	I115		
N2 GENERATOR		3	N1		
TOTAL ALARM		4	I116		
SPARE		5			
		6			


LOCATION			FIELD(설비동)		
		(1)			LP COMP
		(2,4)			FLAME DETECTOR
		(3)			FD-001

LOCATION	NG-101 N2 GENERATOR (UTILITY동)		
	WIRE No.	TB No.	DESCRIPTION
-----	DCS COM	45	N2 GENERATOR
-----	P029R	42	RUNNING STATUS
-----		45	N2 GENERATOR
-----	P02BR	44	TOTAL ALARM

- LOCAL CABLE WORK & SCOPE
- KWANG SHIN CABLE WORK & SCOPE

REFERENCE

					
					
FOR REFERENCE		D.H.LEE			J.S.KO
REV.	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이버스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION		UNITS			
		CABLE INTERCONNECTION DIAGRAM			
SHT. NO.	SCALE	DWG. NO.			
11/17	N.S	P-415-00			

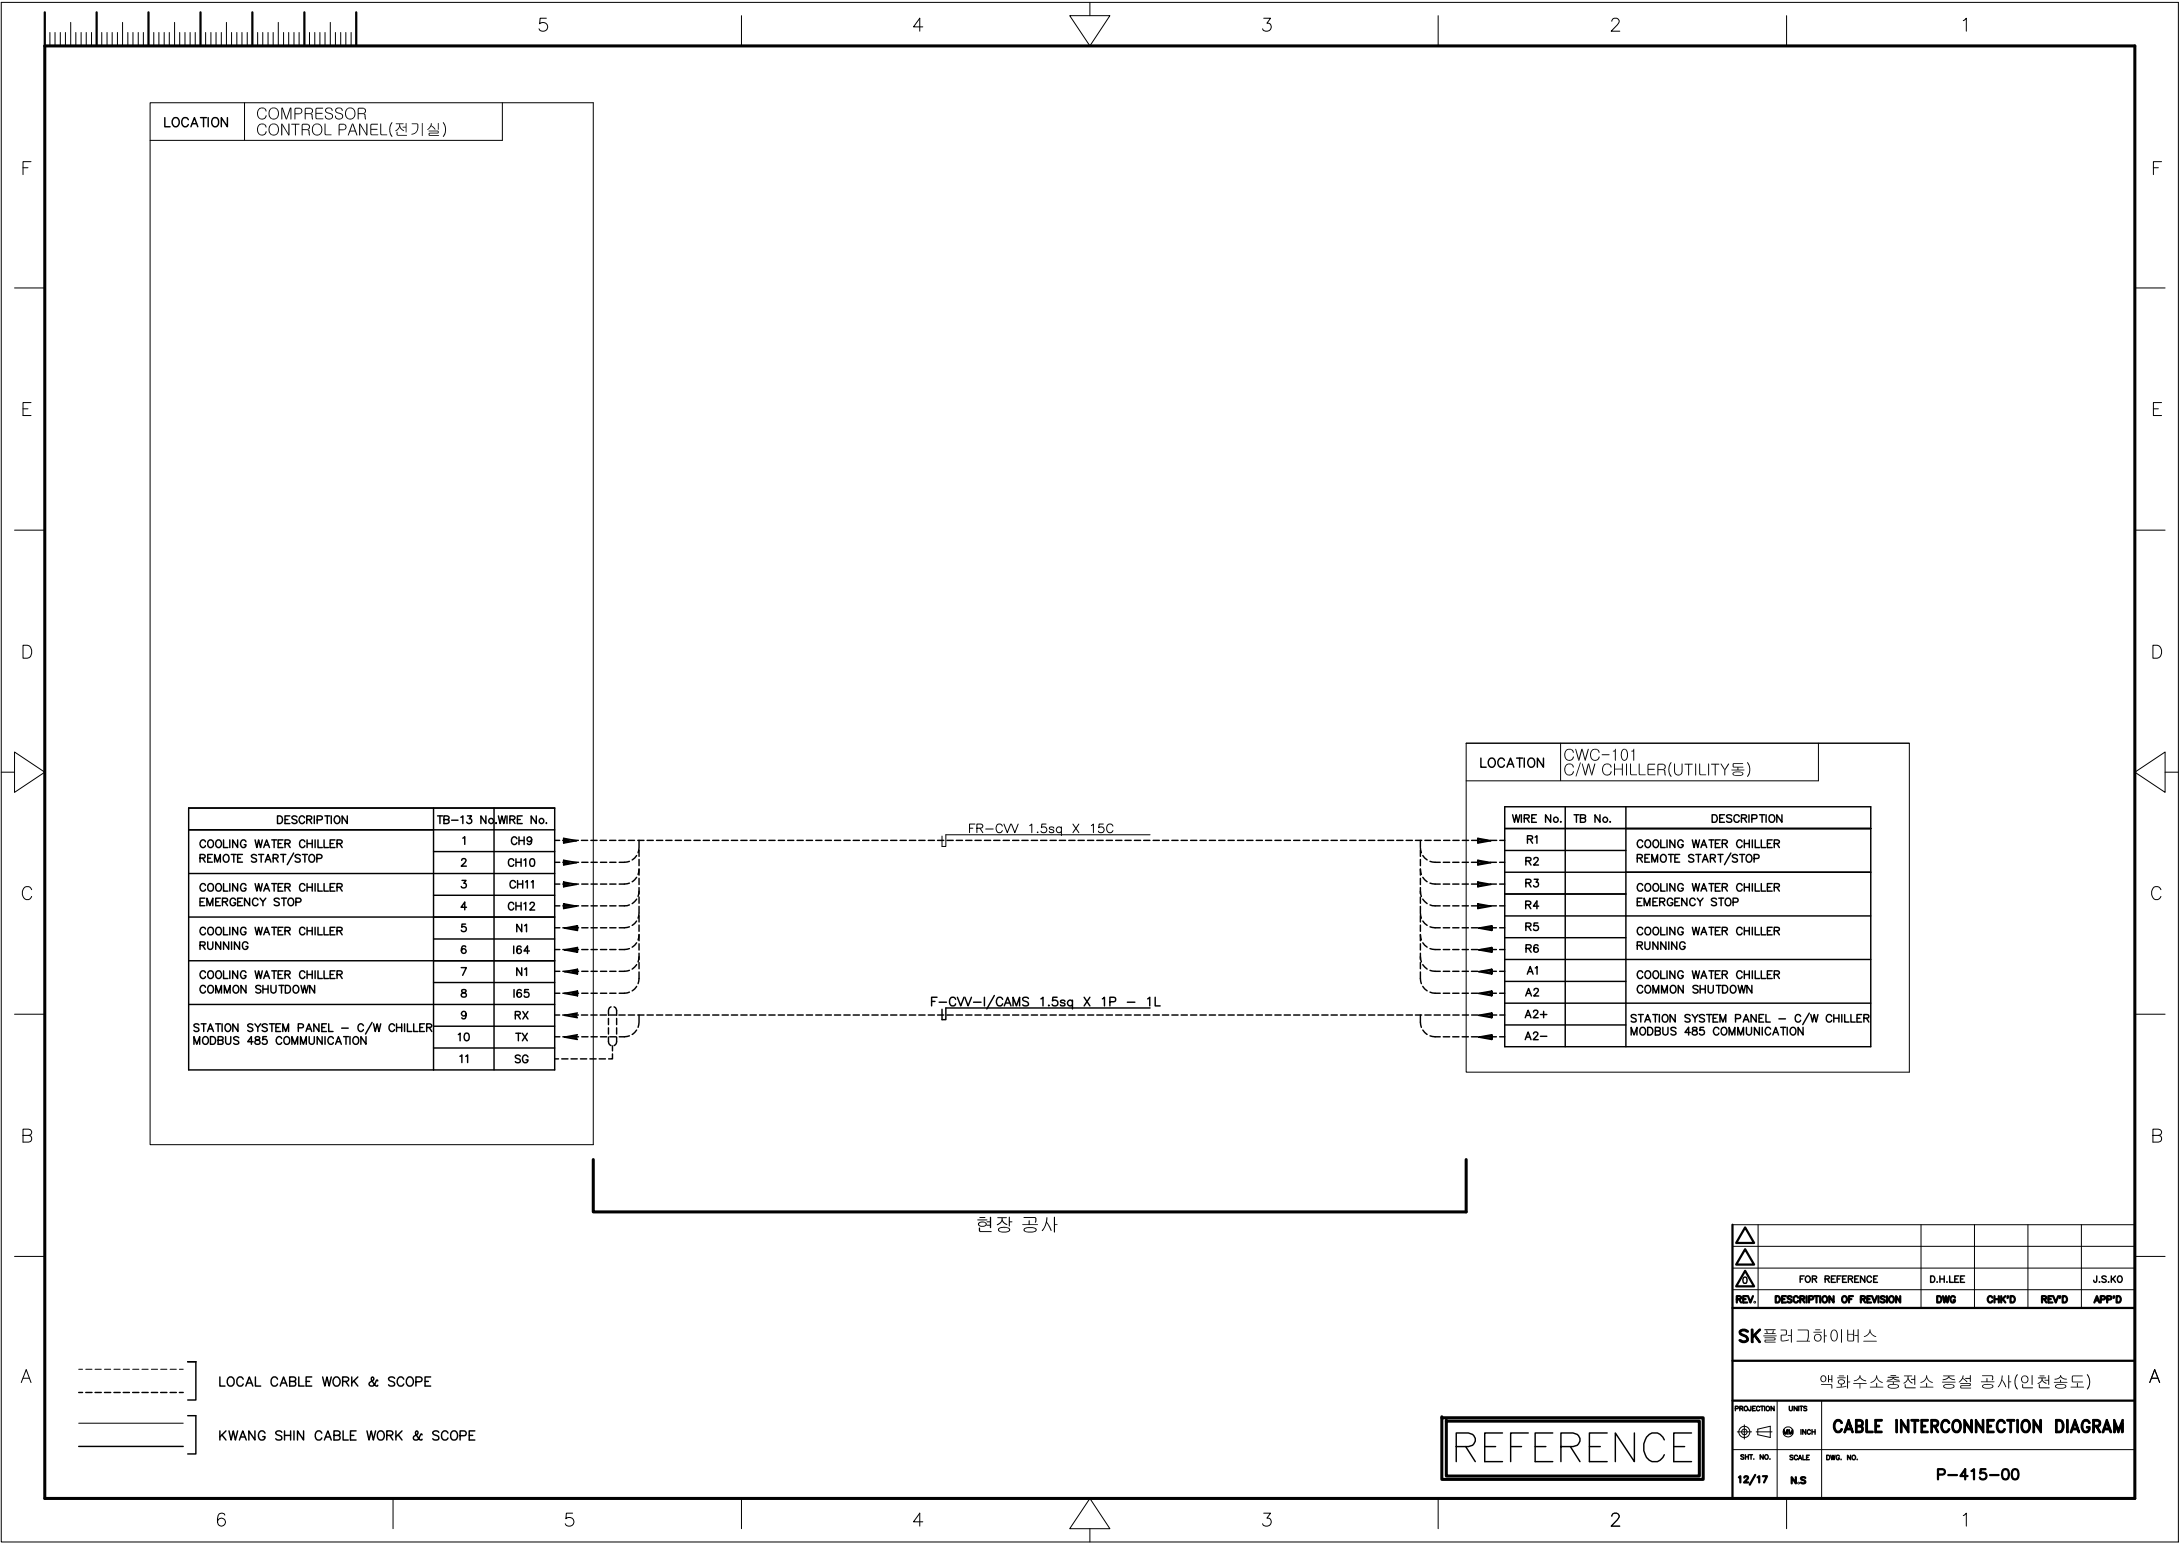

LOCATION COMPRESSOR CONTROL PANEL(전기실)

DESCRIPTION	TB-13 No.	WIRE No.
COOLING WATER CHILLER REMOTE START/STOP	1	CH9
	2	CH10
COOLING WATER CHILLER EMERGENCY STOP	3	CH11
	4	CH12
COOLING WATER CHILLER RUNNING	5	N1
	6	I64
COOLING WATER CHILLER COMMON SHUTDOWN	7	N1
	8	I65
STATION SYSTEM PANEL - C/W CHILLER MODBUS 485 COMMUNICATION	9	RX
	10	TX
	11	SG

LOCATION CWC-101 C/W CHILLER(UTILITY동)

WIRE No.	TB No.	DESCRIPTION
R1		COOLING WATER CHILLER REMOTE START/STOP
R2		
R3		COOLING WATER CHILLER EMERGENCY STOP
R4		
R5		COOLING WATER CHILLER RUNNING
R6		
A1		COOLING WATER CHILLER COMMON SHUTDOWN
A2		
A2+		STATION SYSTEM PANEL - C/W CHILLER MODBUS 485 COMMUNICATION
A2-		

FR-CW 1.5sq X 15C


F-CW-I/CAMS 1.5sq X 1P - 1L

현장 공사

- LOCAL CABLE WORK & SCOPE
- KWANG SHIN CABLE WORK & SCOPE


REFERENCE

△					
△					
	FOR REFERENCE	D.H.LEE			J.S.KO
REV.	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
	SK플러그하이버스				
	액화수소충전소 증설 공사(인천송도)				
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
12/17	N.S	SHT. NO.	SCALE	DWG. NO.	P-415-00

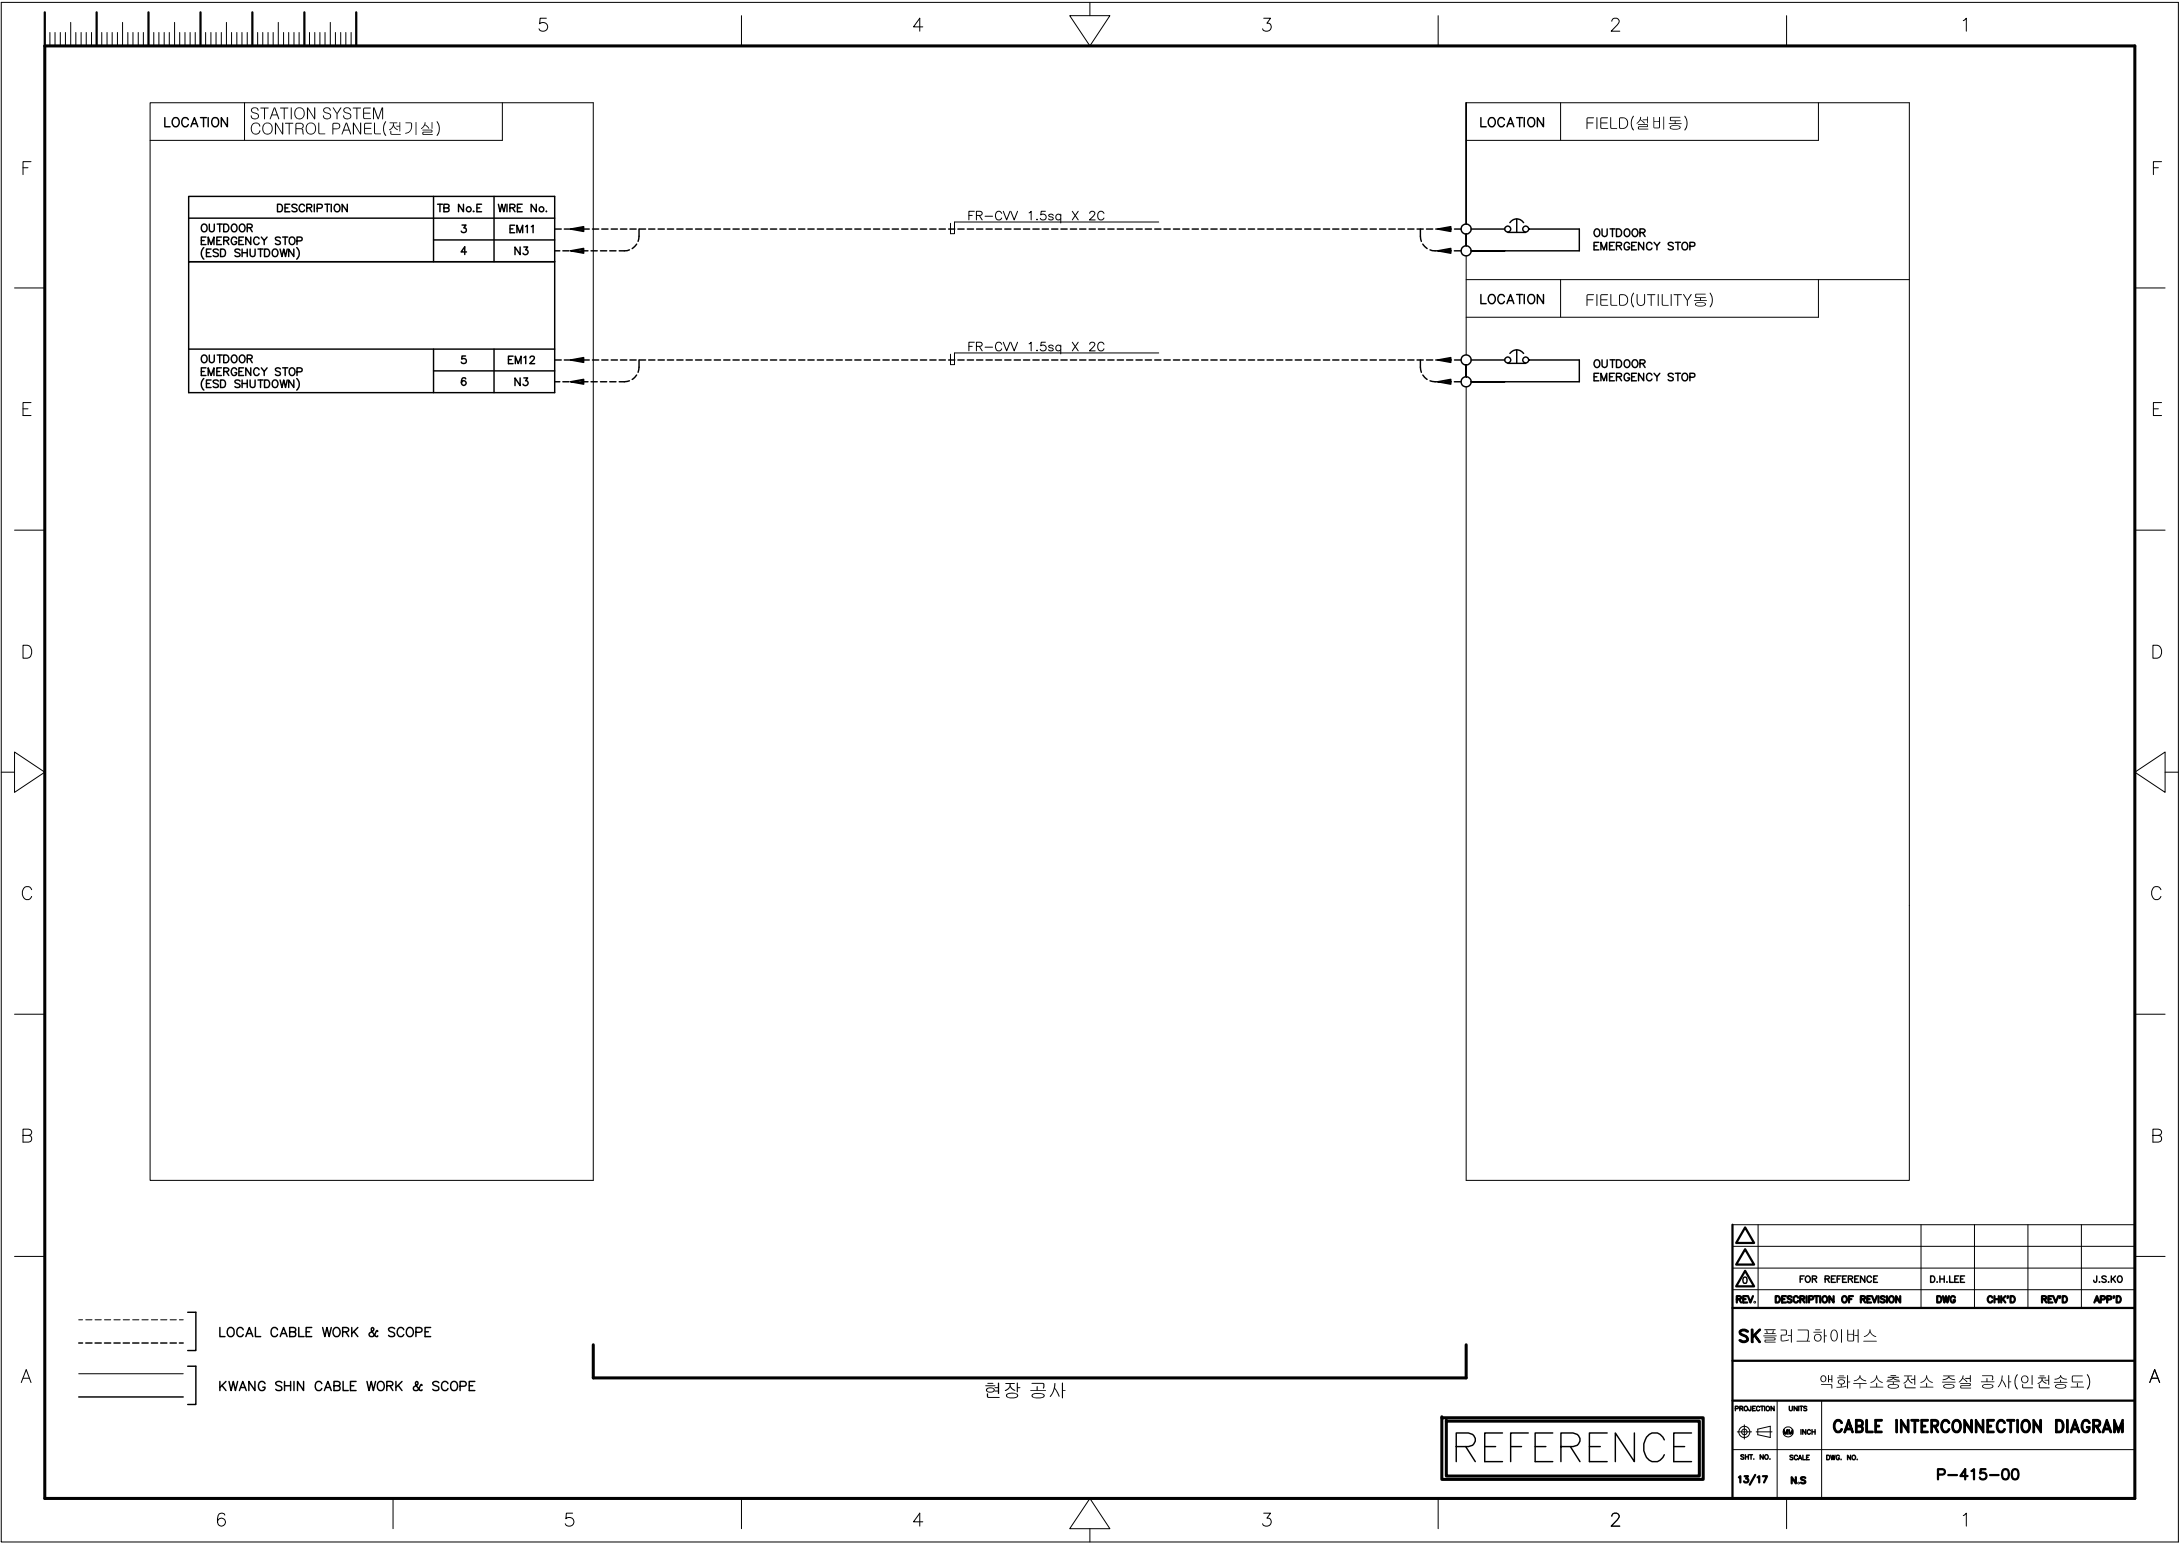

	FOR REFERENCE	D.H.LEE			J.S.KO
REV.	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이버스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
	INCH	SHT. NO.	SCALE	DWG. NO.	
13/17	N.S			P-415-00	

REFERENCE

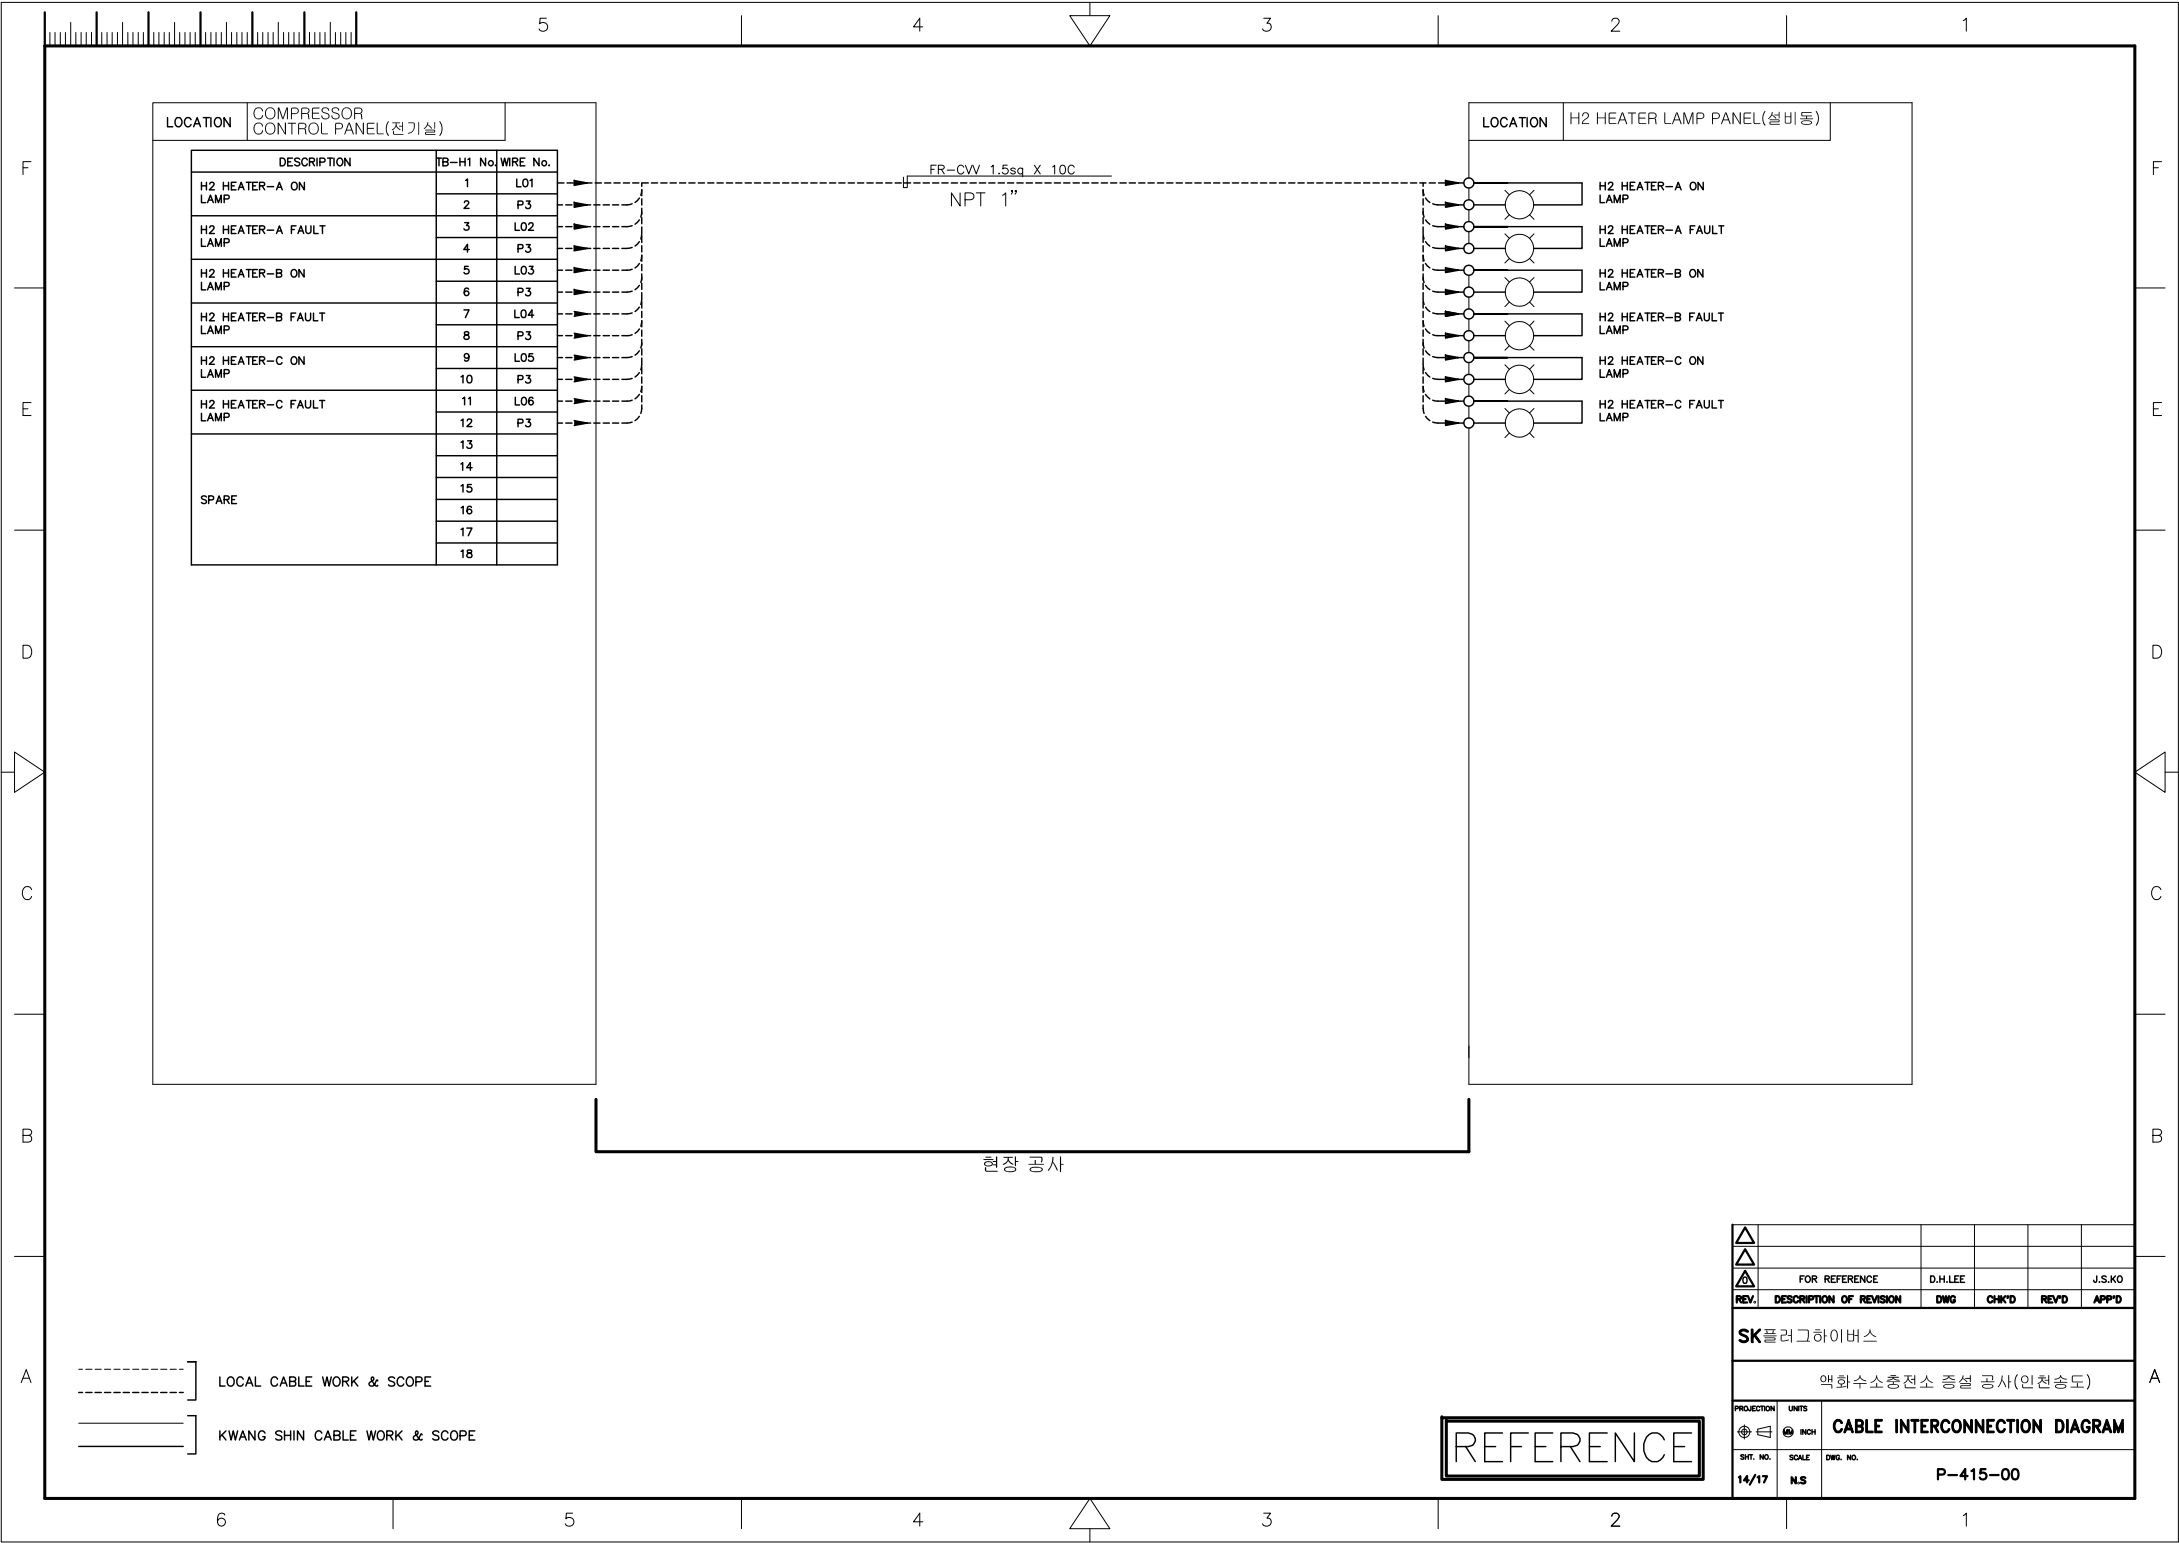

LOCATION COMP CONTROL PANEL(전기실)		
DESCRIPTION	TB-1 No.	WIRE No.
LP COMP RUN LAMP	1	L01
	2	P3
LP COMP STOP LAMP	3	L02
	4	P3
MAIN OIL PUMP RUN LAMP	5	L03
	6	P3
MAIN OIL PUMP STOP LAMP	7	L04
	8	P3
READY TO START LAMP	9	L05
	10	P3
LUBE OIL HEATER ON LAMP	11	L06
	12	P3
LUBE OIL HEATER OFF LAMP	13	L07
	14	P3
COMMON SHUTDOWN LAMP	15	L08
	16	P3
SPARE	17	
	18	
	19	
	20	
LOCAL/REMOTE SELECTOR SWITCH	21	P3
	22	C01
	23	C02
LP COMP START PB SWITCH	24	P3
LP COMP STOP PB SWITCH	25	C03
LP COMP LAMP TEST PB SWITCH	26	P3
LP COMP LOCAL EMERGENCY STOP PB SWITCH	27	C04
	28	P3
	29	C05
	30	P3
	31	C06

LOCATION LP COMP LSB(설비동)		
LP COMP RUN LAMP		
LP COMP STOP LAMP		
MAIN OIL PUMP RUN LAMP		
MAIN OIL PUMP STOP LAMP		
READY TO START LAMP		
LUBE OIL HEATER ON LAMP		
LUBE OIL HEATER OFF LAMP		
COMMON SHUTDOWN LAMP		
LOCAL/REMOTE SELECTOR SWITCH		
LP COMP START PB SWITCH		
LP COMP STOP PB SWITCH		
LP COMP LAMP TEST PB SWITCH		
LP COMP LOCAL EMERGENCY STOP		

FR-CW 1.5sq X 20C
NPT 1-1/4"

FR-CW 1.5sq X 15C
NPT 1"

현장 공사

LOCAL CABLE WORK & SCOPE

KWANG SHIN CABLE WORK & SCOPE

REFERENCE

△					
△					
△	FOR REFERENCE	D.H.LEE			J.S.KO
REV.	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이버스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
15/17	N.S	SCALE	DWG. NO.	P-415-00	

F

E

D

C

B

A

F

E

D

C

B

A

LOCATION	COMP CONTROL PANEL(전기실)	
DESCRIPTION	TB-2 No.	WIRE No.
LP COMP INLET ACTUATOR VALVE VV-401(XV-401)	1	SOL11
	2	N3
LP COMP OUTLET ACTUATOR VALVE VV-402(XV-402)	3	SOL21
	4	N3
LP COMP RECYCLE ACTUATOR VALVE VV-403(XV-403)	5	SOL31
	6	N3
LP COMP VENT ACTUATOR VALVE VV-404(XV-404)	7	SOL41
	8	N3
LP COMP BYPASS SOLENOID VALVE VV-405(XV-405)	9	SOL51
	10	N3
LP COMP N2 PURGE SOLENOID VALVE XV-406	11	SOL61
	12	N3
LP COMP START-UP SOLENOID VALVE XV-407	13	SOL71
	14	N3
LP COMP OIL START-UP ACTUATOR VALVE VV-501(XV-501)	15	SOL18
	16	N3
SPARE	17	
	18	
SPARE	19	
	20	
LP COMP INLET ACTUATOR VALVE OPEN/CLOSE POSITION ZSO/ZSC-401	21	N1
	22	I40
	23	I41
LP COMP OUTLET ACTUATOR VALVE OPEN/CLOSE POSITION ZSO/ZSC-402	24	N1
	25	I42
	26	I43
LP COMP RECYCLE ACTUATOR VALVE OPEN/CLOSE POSITION ZSO/ZSC-403	27	N1
	28	I44
	29	I45
LP COMP VENT ACTUATOR VALVE OPEN/CLOSE POSITION ZSO/ZSC-404	30	N1
	31	I46
	32	I47
LP COMP BYPASS ACTUATOR VALVE OPEN/CLOSE POSITION ZSO/ZSC-405	33	N1
	34	I50
	35	I51
LP COMP N2 PURGE SUPPLY VALVE OPEN/CLOSE POSITION ZSO/ZSC-406	36	N1
	37	I52
	38	I53
LP COMP OIL START-UP ACTUATOR VALVE OPEN/CLOSE POSITION ZSO/ZSC-501	39	I54
	40	I55
LP COMP 3rd CYL GAS LEAKAGE PRESS SWITCH PS-405	41	N1
	42	I56
LP COMP FRAME VIBRATION SWITCH VS-401	43	N1
	44	I57
C/W F/W SWITCH FS-601	45	N1
	46	I66

LOCATION	LP COMP JB-1(설비동)	
WIRE No.	TB No.	WIRE No.
SOL11	1	SOL11
N3	2	N3
SOL12	3	SOL12
N3	4	N3
SOL13	5	SOL13
N3	6	N3
SOL14	7	SOL14
N3	8	N3
SOL15	9	SOL15
N3	10	N3
SOL16	11	SOL16
N3	12	N3
SOL17	13	SOL17
N3	14	N3
SOL18	15	SOL18
N3	16	N3
	17	
	18	
	19	
	20	
N1	21	N1
I40	22	I40
I41	23	I41
N1	24	N1
I42	25	I42
I43	26	I43
N1	27	N1
I44	28	I44
I45	29	I45
N1	30	N1
I46	31	I46
I47	32	I47
N1	33	N1
I50	34	I50
I51	35	I51
N1	36	N1
I52	37	I52
I53	38	I53
N1	COM	N1
I54	39	I54
I55	40	I55
N1	41	N1
I56	42	I56
N1	43	N1
I57	44	I57
N1	45	N1
I66	46	I66

LOCATION	LP COMP(설비동)	
LP COMP INLET ACTUATOR VALVE VV-401(XV-401)		
LP COMP OUTLET ACTUATOR VALVE VV-402(XV-402)		
LP COMP RECYCLE ACTUATOR VALVE VV-403(XV-403)		
LP COMP VENT ACTUATOR VALVE VV-404(XV-404)		
LP COMP BYPASS SOLENOID VALVE VV-405(XV-405)		
LP COMP N2 PURGE ACTUATOR VALVE VV-406(XV-406)		
LP COMP START-UP SOLENOID VALVE XV-407		
LP COMP OIL START-UP ACTUATOR VALV VV-501(XV-501)		
LP COMP INLET ACT VAVLE POSITION LIMIT SWITCH ZSO/ZSC-401		
LP COMP OUTLET ACT VAVLE POSITION LIMIT SWITCH ZSO/ZSC-402		
LP COMP RECYCLE ACT VAVLE POSITION LIMIT SWITCH ZSO/ZSC-403		
LP COMP VENT ACT VAVLE POSITION LIMIT SWITCH ZSO/ZSC-404		
LP COMP BYPASS ACT VAVLE POSITION LIMIT SWITCH ZSO/ZSC-405		
LP COMP N2 PURGE SUPPLY VALVE OPEN/CLOSE POSITION ZSO/ZSC-406		
LP COMP OIL START-UP ACT VAVLE POSITION LIMIT SWITCH ZSO/ZSC-501		
LP COMP 3rd CYL GAS LEAKAGE PRESS SWITCH PS-405		
LP COMP FRAME VIBRATION SWITCH VS-401		
C/W F/W SWITCH FS-601		

현장 공사

----- LOCAL CABLE WORK & SCOPE

===== KWANG SHIN CABLE WORK & SCOPE

REFERENCE

△					
△					
REV.	DESCRIPTION OF REVISION	DWG	CHK'D	REV'D	APP'D
SK플러그하이버스					
액화수소충전소 증설 공사(인천송도)					
PROJECTION	UNITS	CABLE INTERCONNECTION DIAGRAM			
SHI. NO.	SCALE	DWG. NO.			
16/17	N.S	P-415-00			

6


5

4

3

2

1

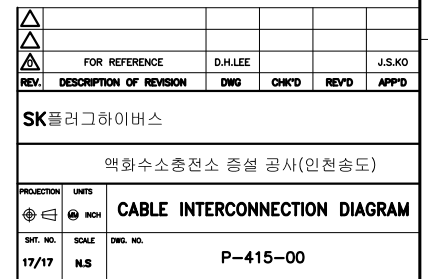

6	5	4		3	2	1
---	---	---	---	---	---	---